

POWER 7LO

Electrical Automation (043) 731 2001

Customer : HLUMISA ENG SERVICES
Plant designation : ROBINSON DRY DOCK


Description : PUMPHOUSE RIO
Drawing number :

Designed :	B. GOVENDER	File Path:	POW
Drawn/Traced:	B. GOVENDER		RDDRIO
Checked:	I. WARDLE		
Tested:			
Built:			


Created on :	Highest Page No. :	24
Processed on : 14. Sep. 2022	No. of pages :	24

Table Of Contents


Page	Designation	Additional field	Date	Editor
1	TITLE SHEET		14. Sep. 2022	B. G
2	CONTENTS		21. Sep. 2022	B. G
3	MAINS INCOMING 230V-24VDC POWER SUPPLY		20. Sep. 2022	B. G
4	HMI & SWITCH		21. Sep. 2022	B. G
5	INTEERFACE MODULE DIGITAL INPUT MODULES		21. Sep. 2022	B. G
6	DIGITAL INPUT MODULES		21. Sep. 2022	B. G
7	DIGITAL OUTPUT MODULES		21. Sep. 2022	B. G
8	ANALOG INPUT MODULES		22. Sep. 2022	B. G
9	ANALOG INPUT MODULE		22. Sep. 2022	B. G
10	ANALOG OUTPUT MODULE		22. Sep. 2022	B. G
11	DIGITAL INPUT JBOX 1		22. Sep. 2022	B. G
12	DIGITAL INPUTS JBOX 1		22. Sep. 2022	B. G
13	DIGITAL INPUT JBOX 1 & JBOX 2		22. Sep. 2022	B. G
14	DIGITAL INPUTS JBOX 2		22. Sep. 2022	B. G
15	DIGITAL OUTPUTS DELV ISOL VALVES		22. Sep. 2022	B. G
16	ANALOG INPUTS JBOX1 PP-03 TEMP MON		22. Sep. 2022	B. G
17	ANALOG INPUTS JBOX 2 PP-04 TEMP MON		22. Sep. 2022	B. G
18	PUMPS VIBRATION MONITORING JBOX1 & JBOX 2		22. Sep. 2022	B. G
19	ANALOG INPUTS JBOX 1 & JBOX 2 INSTRUMENTATION		22. Sep. 2022	B. G
20	PUMP 1 DELIVERY VALVE CTRR-PH-VD-01		22. Sep. 2022	B. G
21	PUMP 2 DELIVERY VALVE CTRR-PH-VD-02		22. Sep. 2022	B. G
22	PUMP 3 DELIVERY VALVE CTRR-PH-VD-03		22. Sep. 2022	B. G
23	PUMP 4 DELIVERY VALVE CTRR-PH-VD-04		22. Sep. 2022	B. G
24	EMERGENCY STOPS PUMP STATION SAFETY RELAY		22. Sep. 2022	B. G

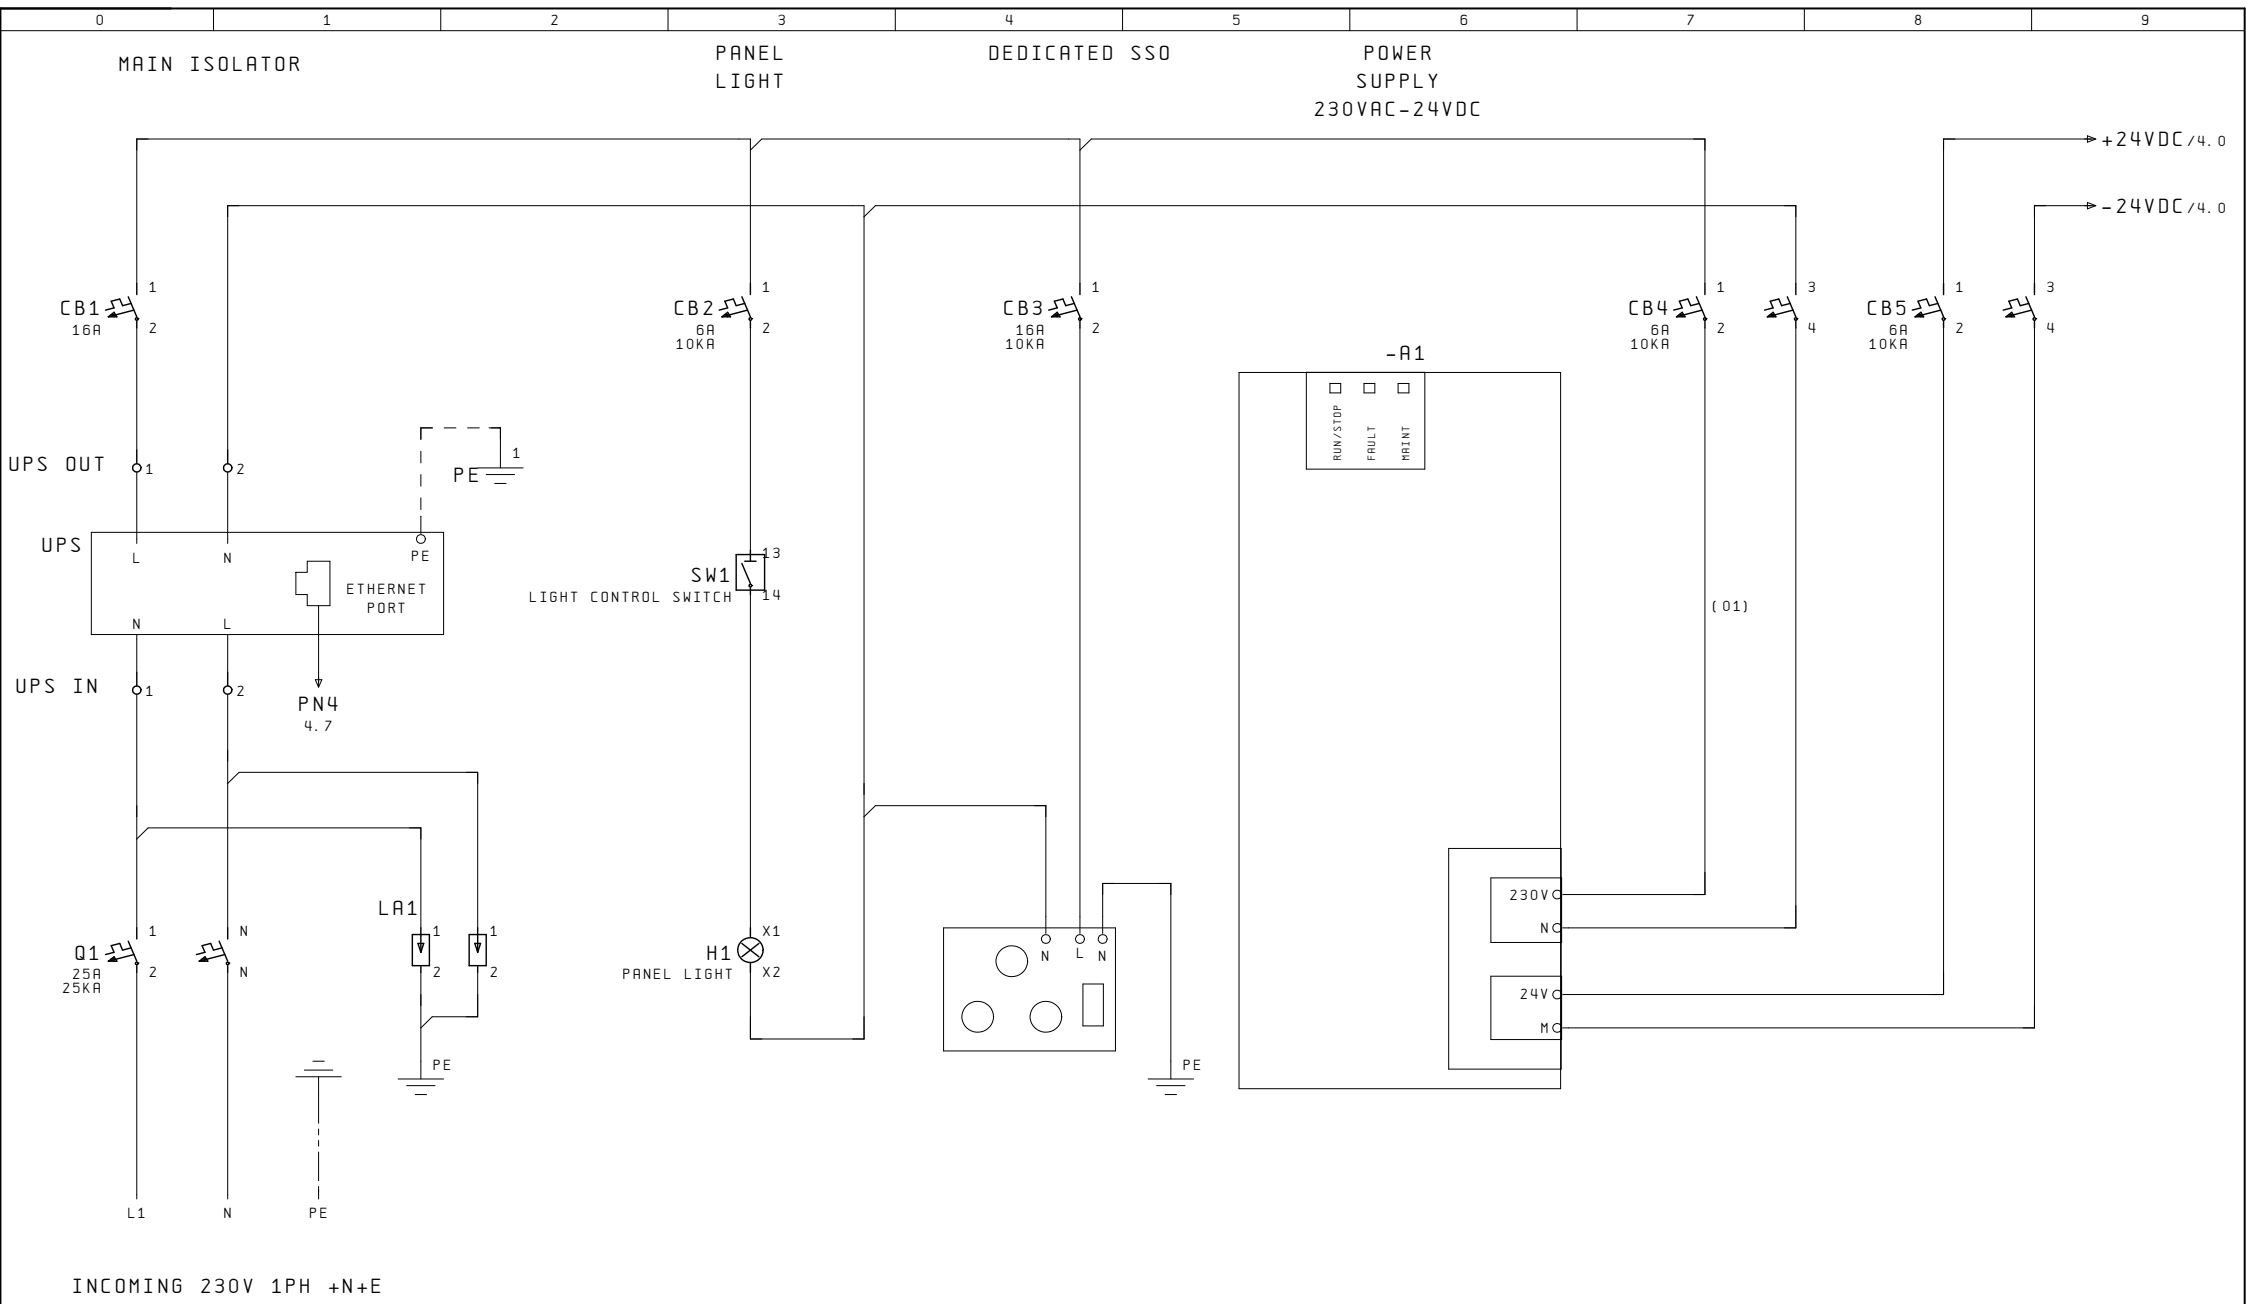



			Date		ROBINSON DRY DOCK		POWER7LO Electrical Automation (043) 731 2001	MAINS INCOMING 230V-24VDC POWER SUPPLY					
			Editor	B. G									
			Tested	22. Sep. 2022									
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.			B. GOVENDER	POW RODRIO		P. 3 24 p.

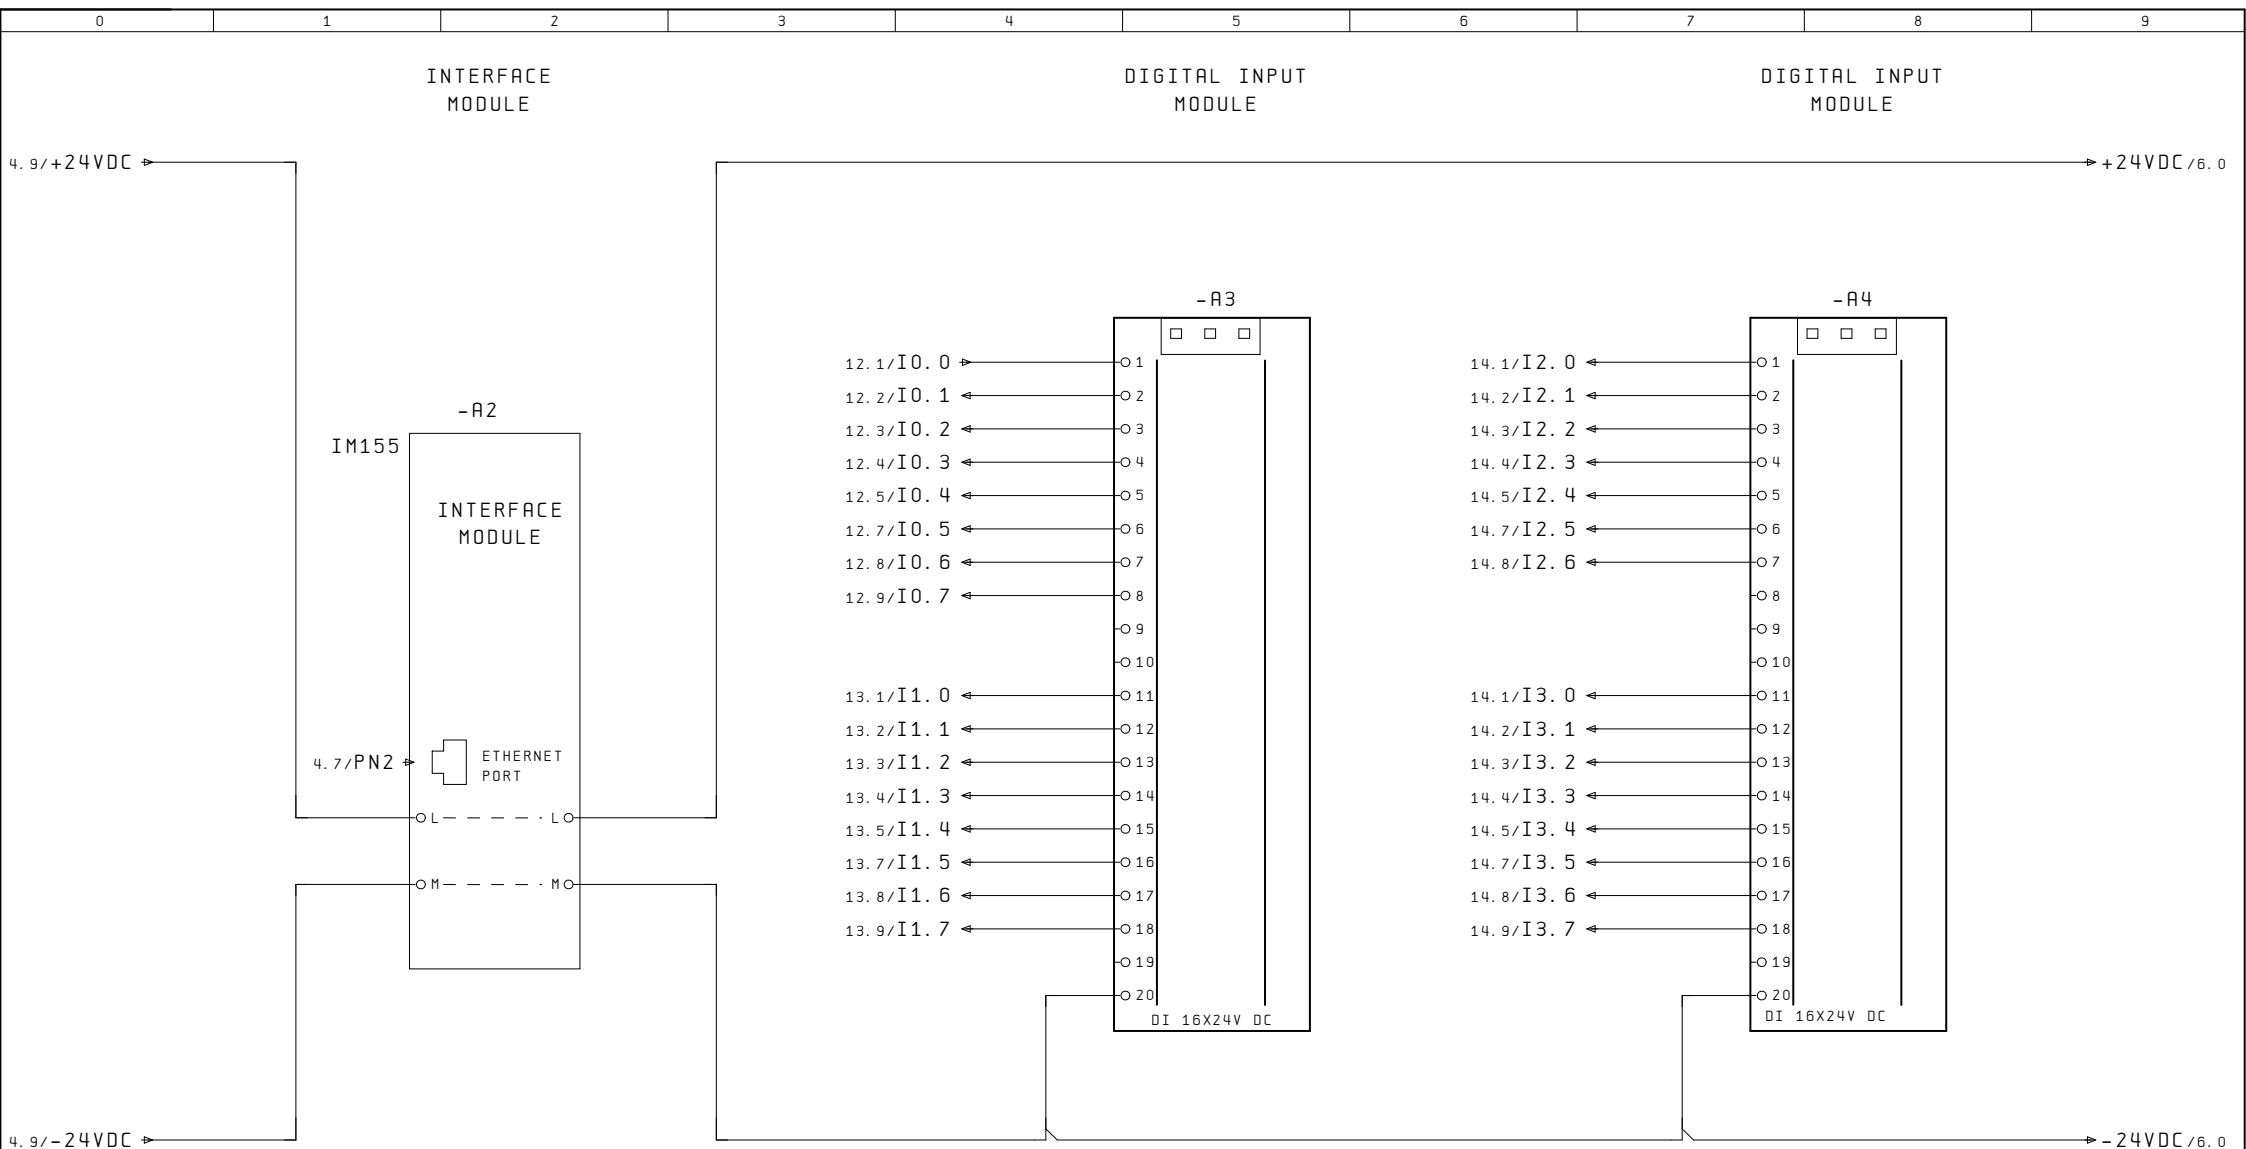

			Date	ROBINSON DRY DOCK			INTERFACE MODULE				=
			Editor	B. G				DIGITAL INPUT MODULES			
			Tested	22. Sep. 2022							
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.			B. GOVENDER	
										POW RODRIO	P. 5
											24 P.

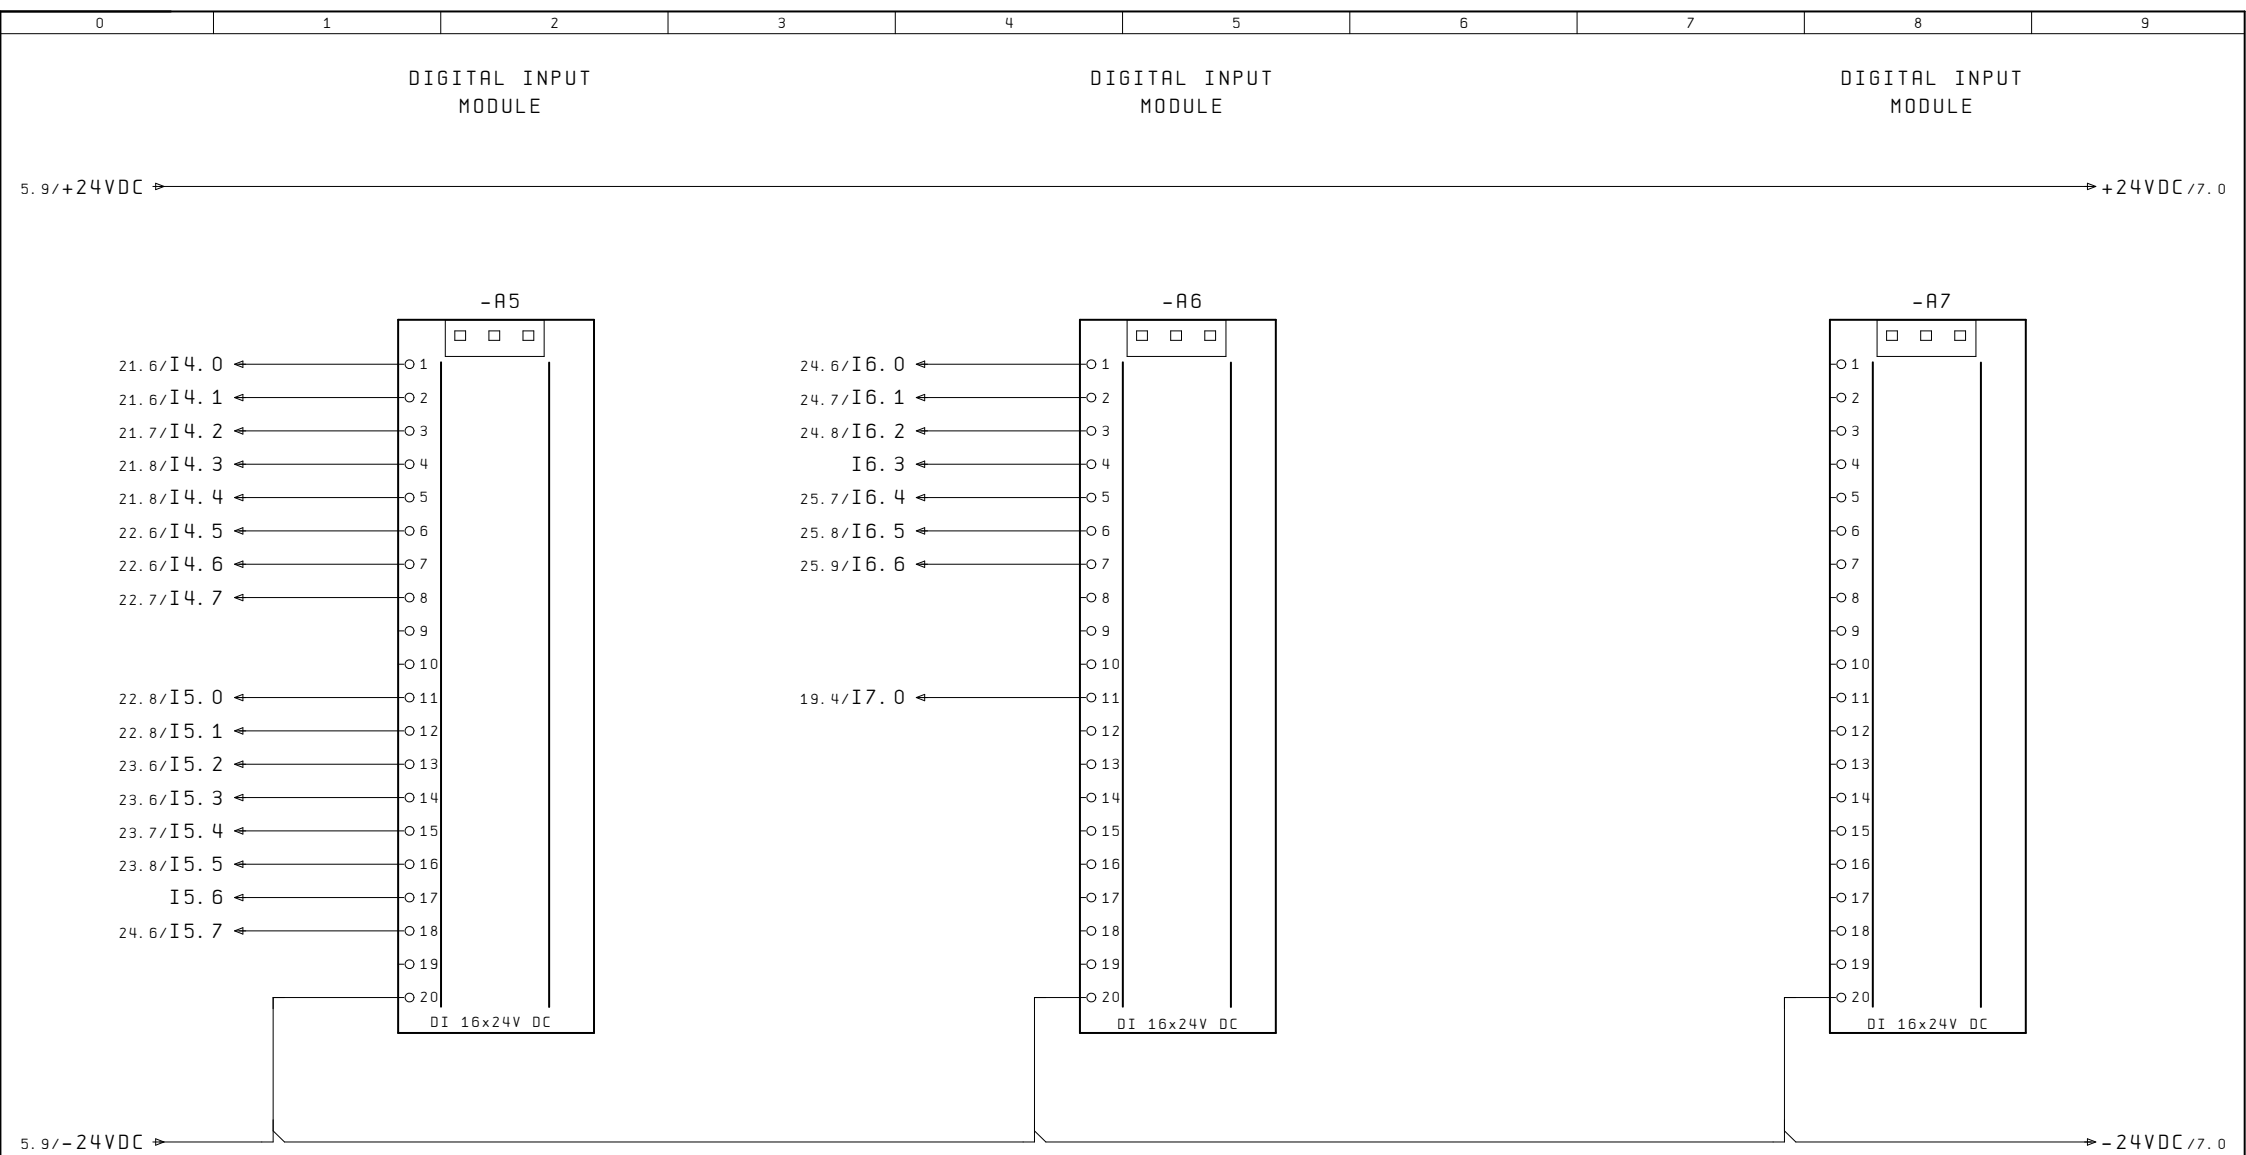

DIGITAL OUTPUT
MODULE

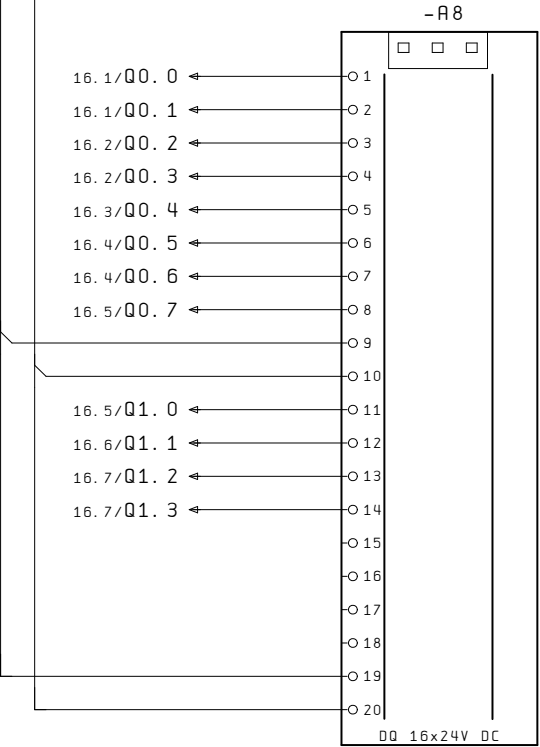


PUMP 3 & 4
TEMPERATURE
MONITORING

INSTRUMENTATION
LEVEL &
PRESSURE


-A9

-A10

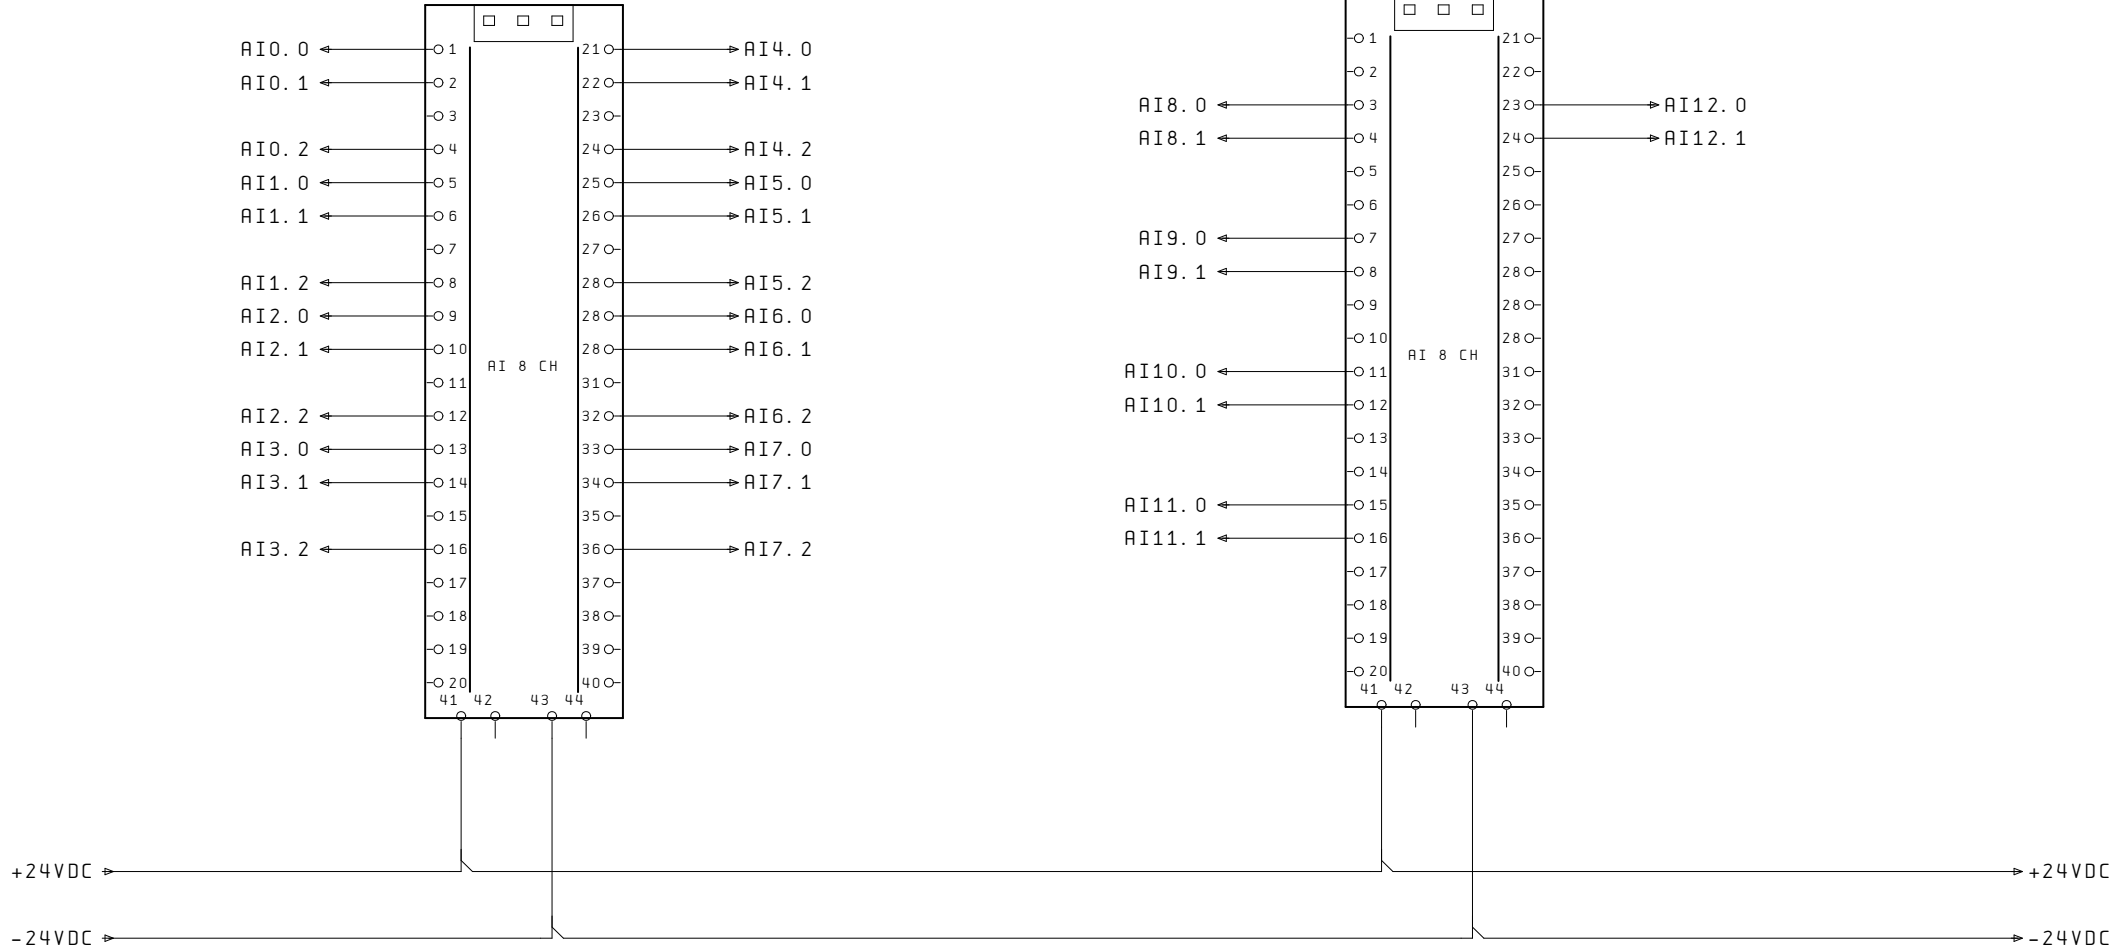

DELIVERY
VALVES
POSITIONS

-A11

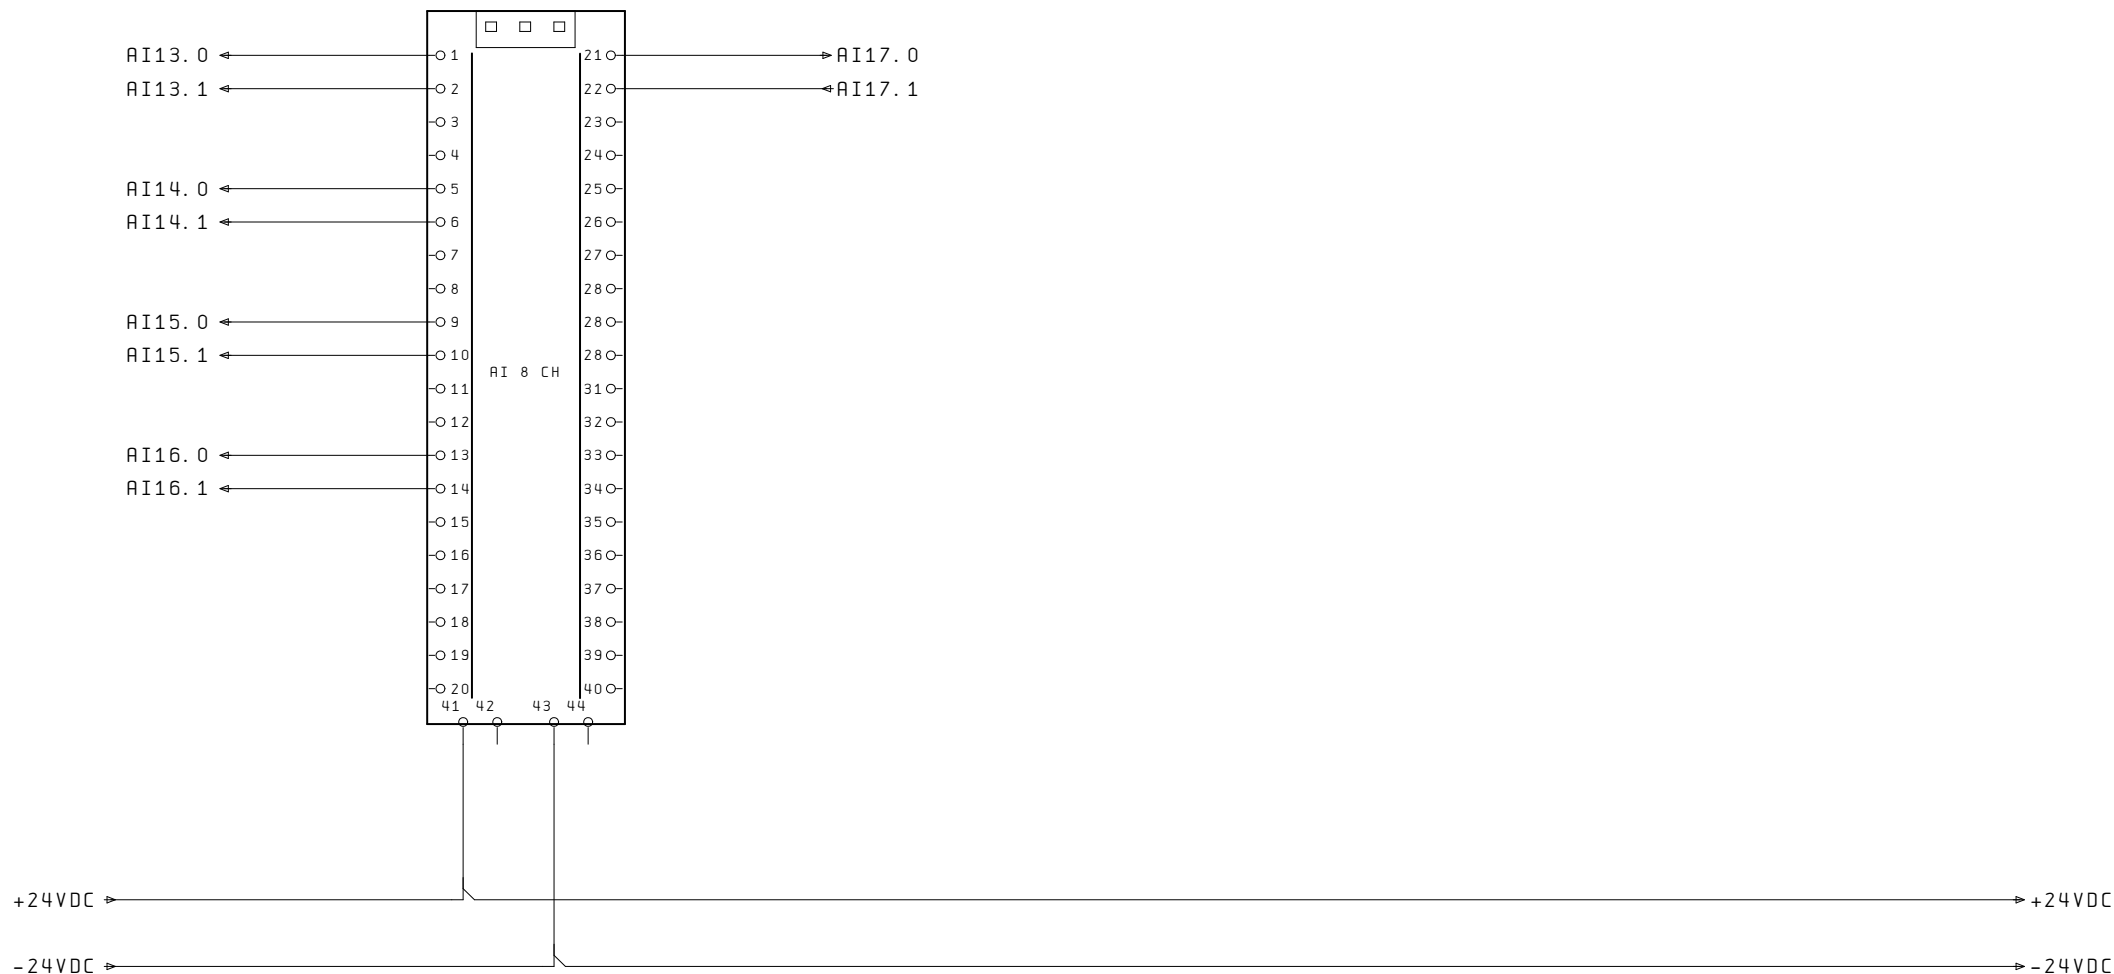



			Date		ROBINSON DRY DOCK		 POWER 710 Electrical Automation (043) 731 2001	ANALOG INPUT MODULE			=	
			Editor	B. G							+	
			Tested	22. Sep. 2022								
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.		B. GOVENDER	POW RDDRIO		P. 9 24 p.

ANALOG OUTPUT
MODULE


+24VDC ←
-24VDC ←


→ +24VDC
→ -24VDC

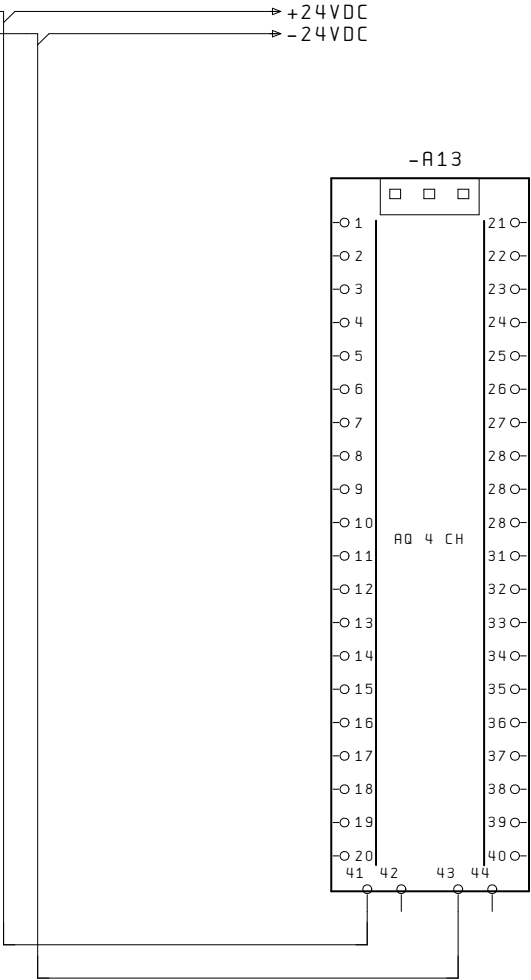

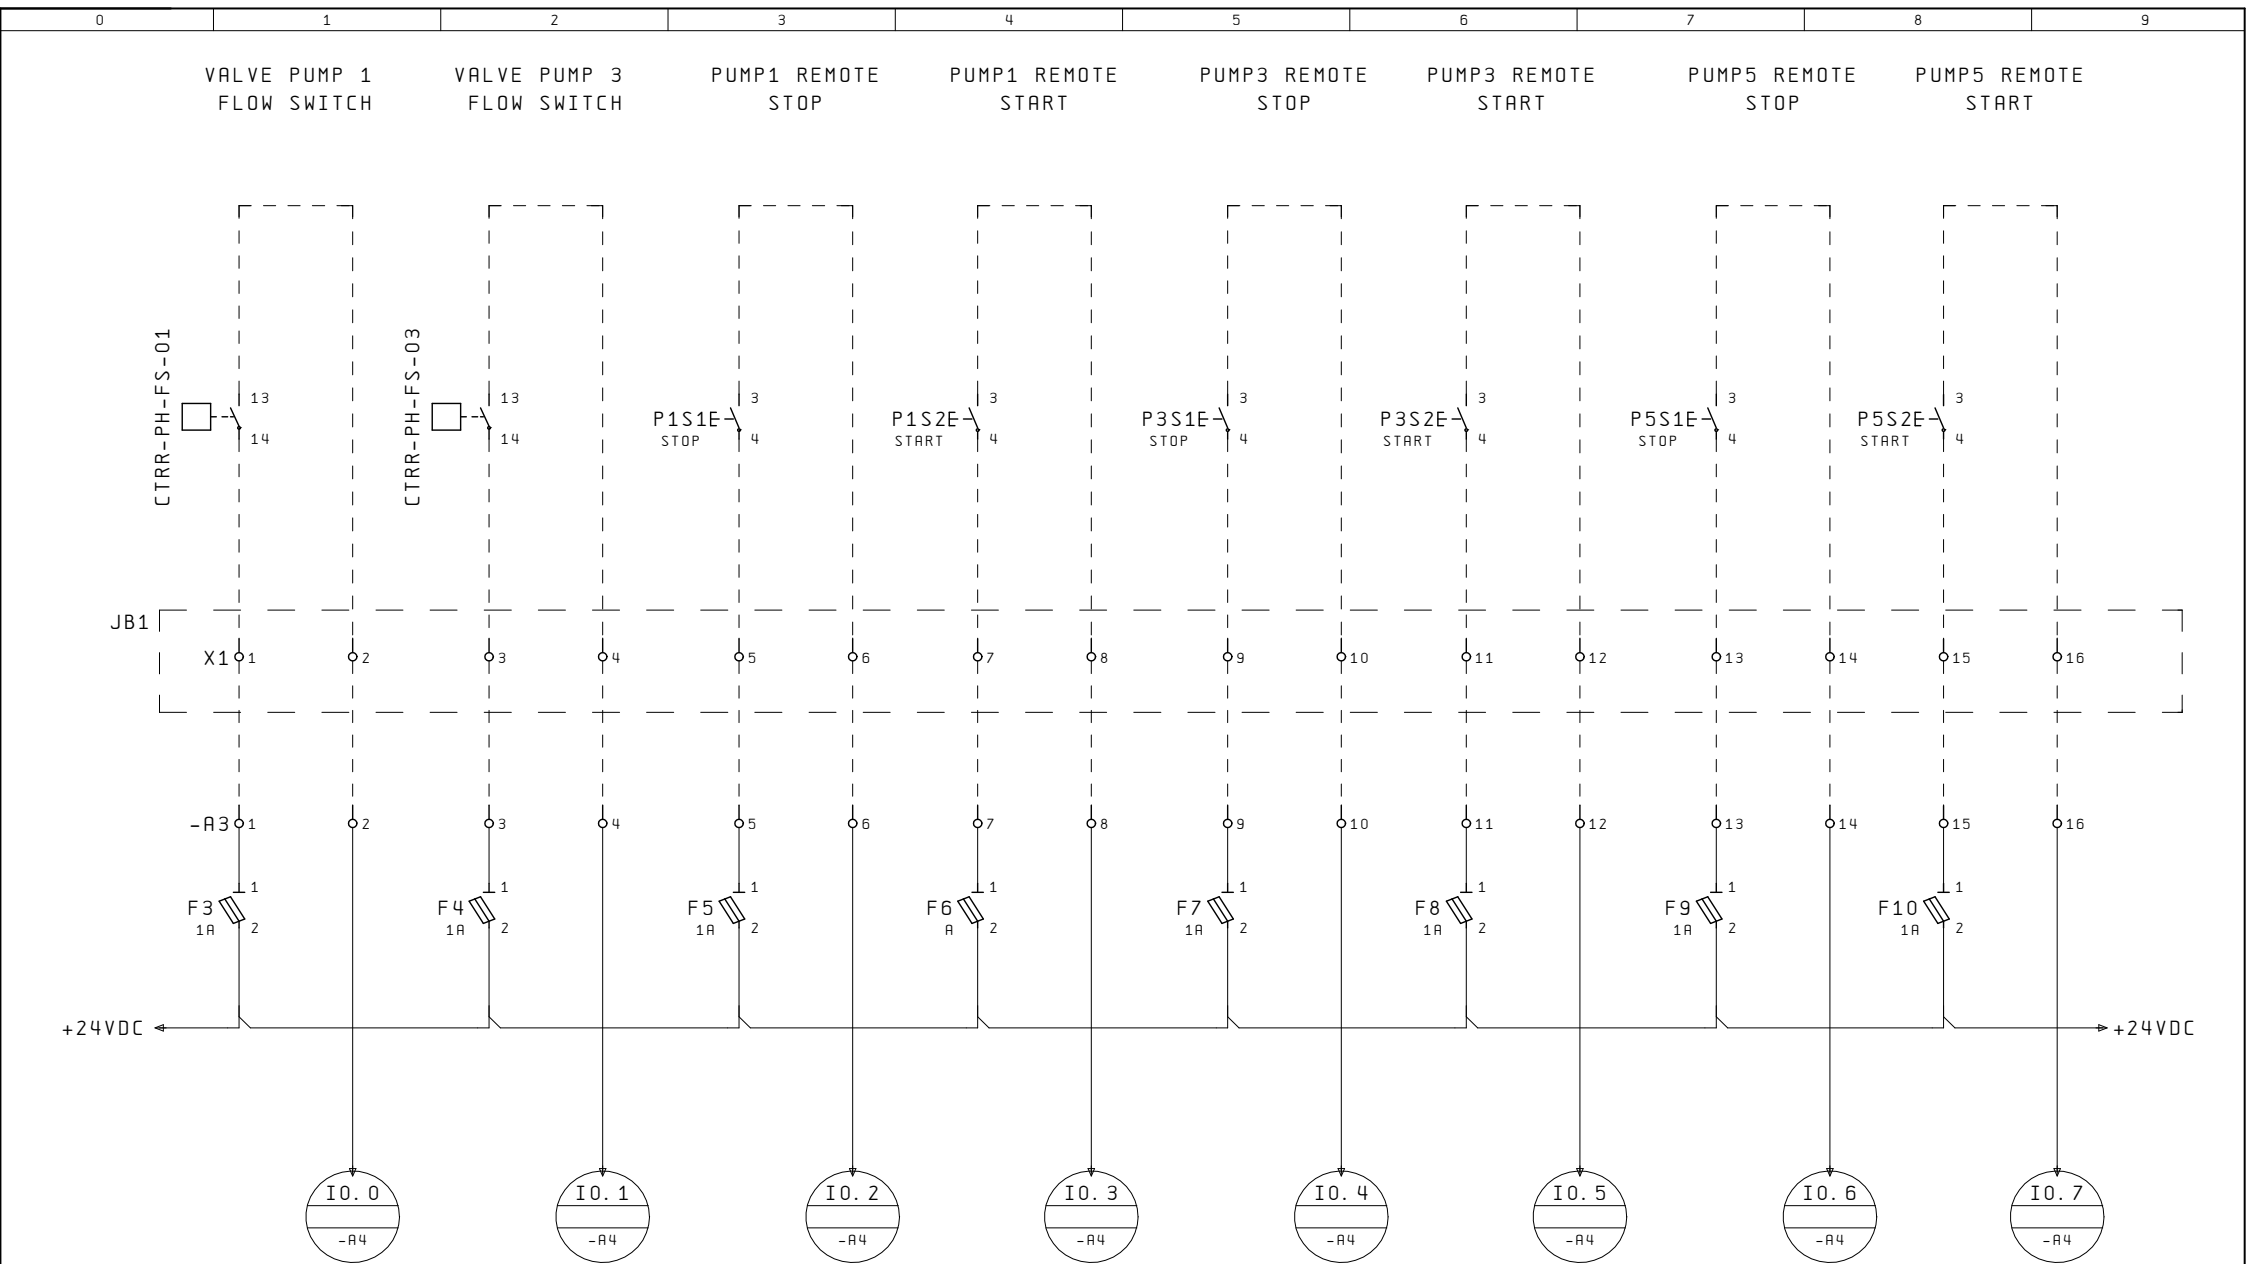


			Date		ROBINSON DRY DOCK			 Electrical Automation (043) 731 2001	DIGITAL INPUT JBOX 1			=	
		Editor	B. G	+									
		Tested	22. Sep. 2022										
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.		B. GOVENDER	POW RODRIO		P. 11	
												24 p.	

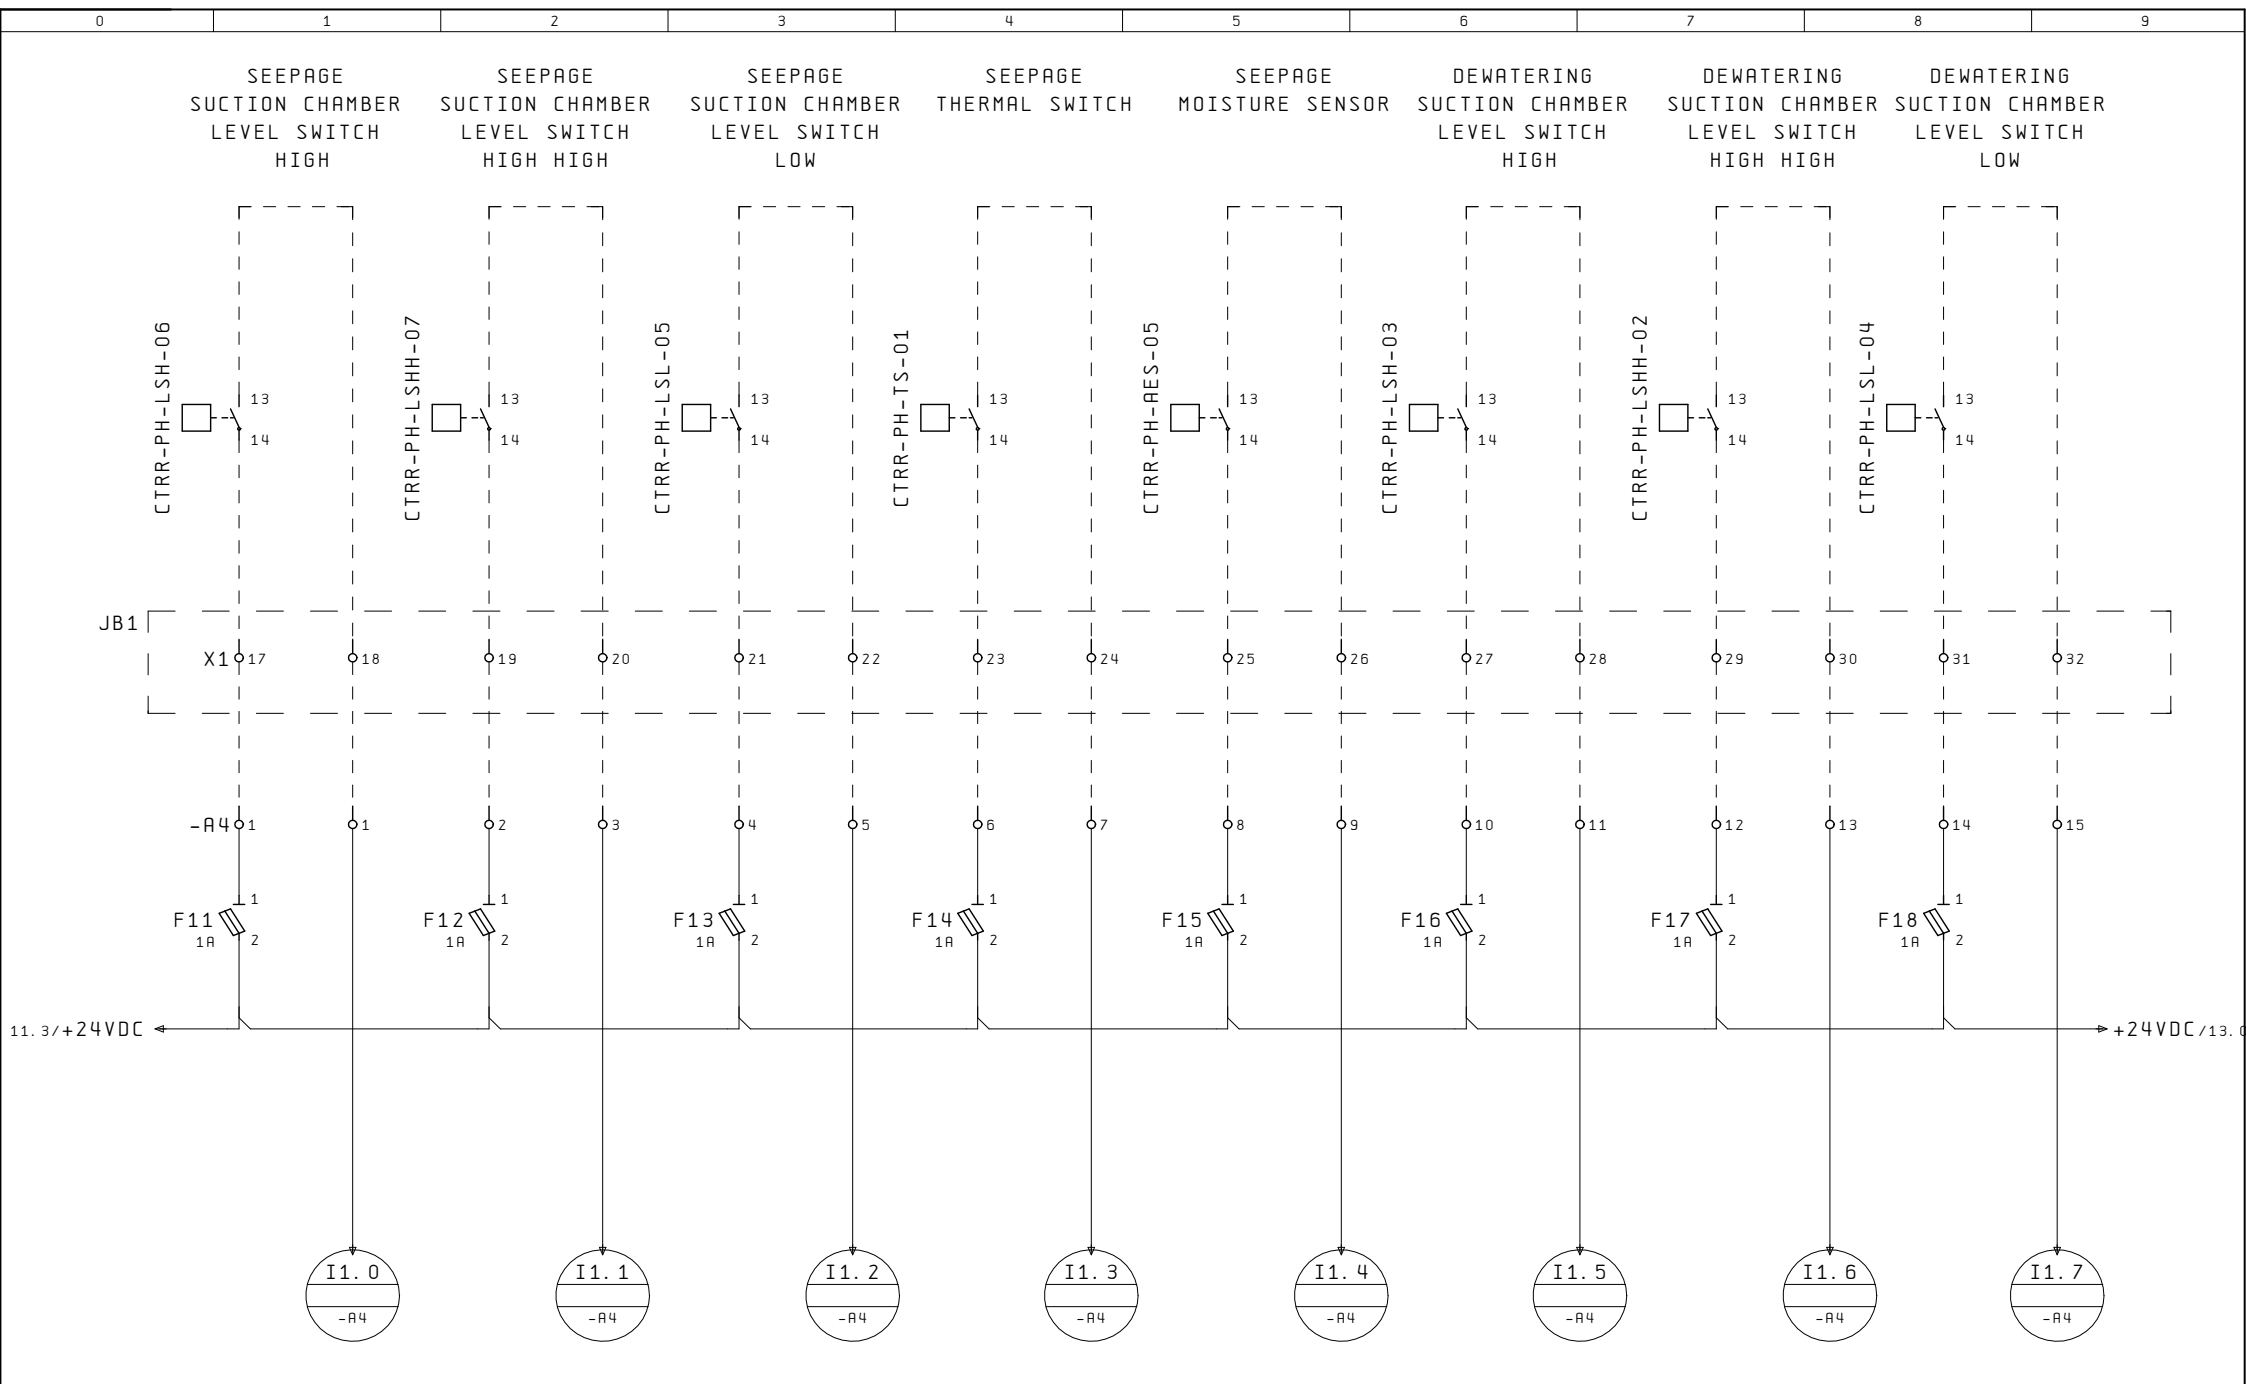


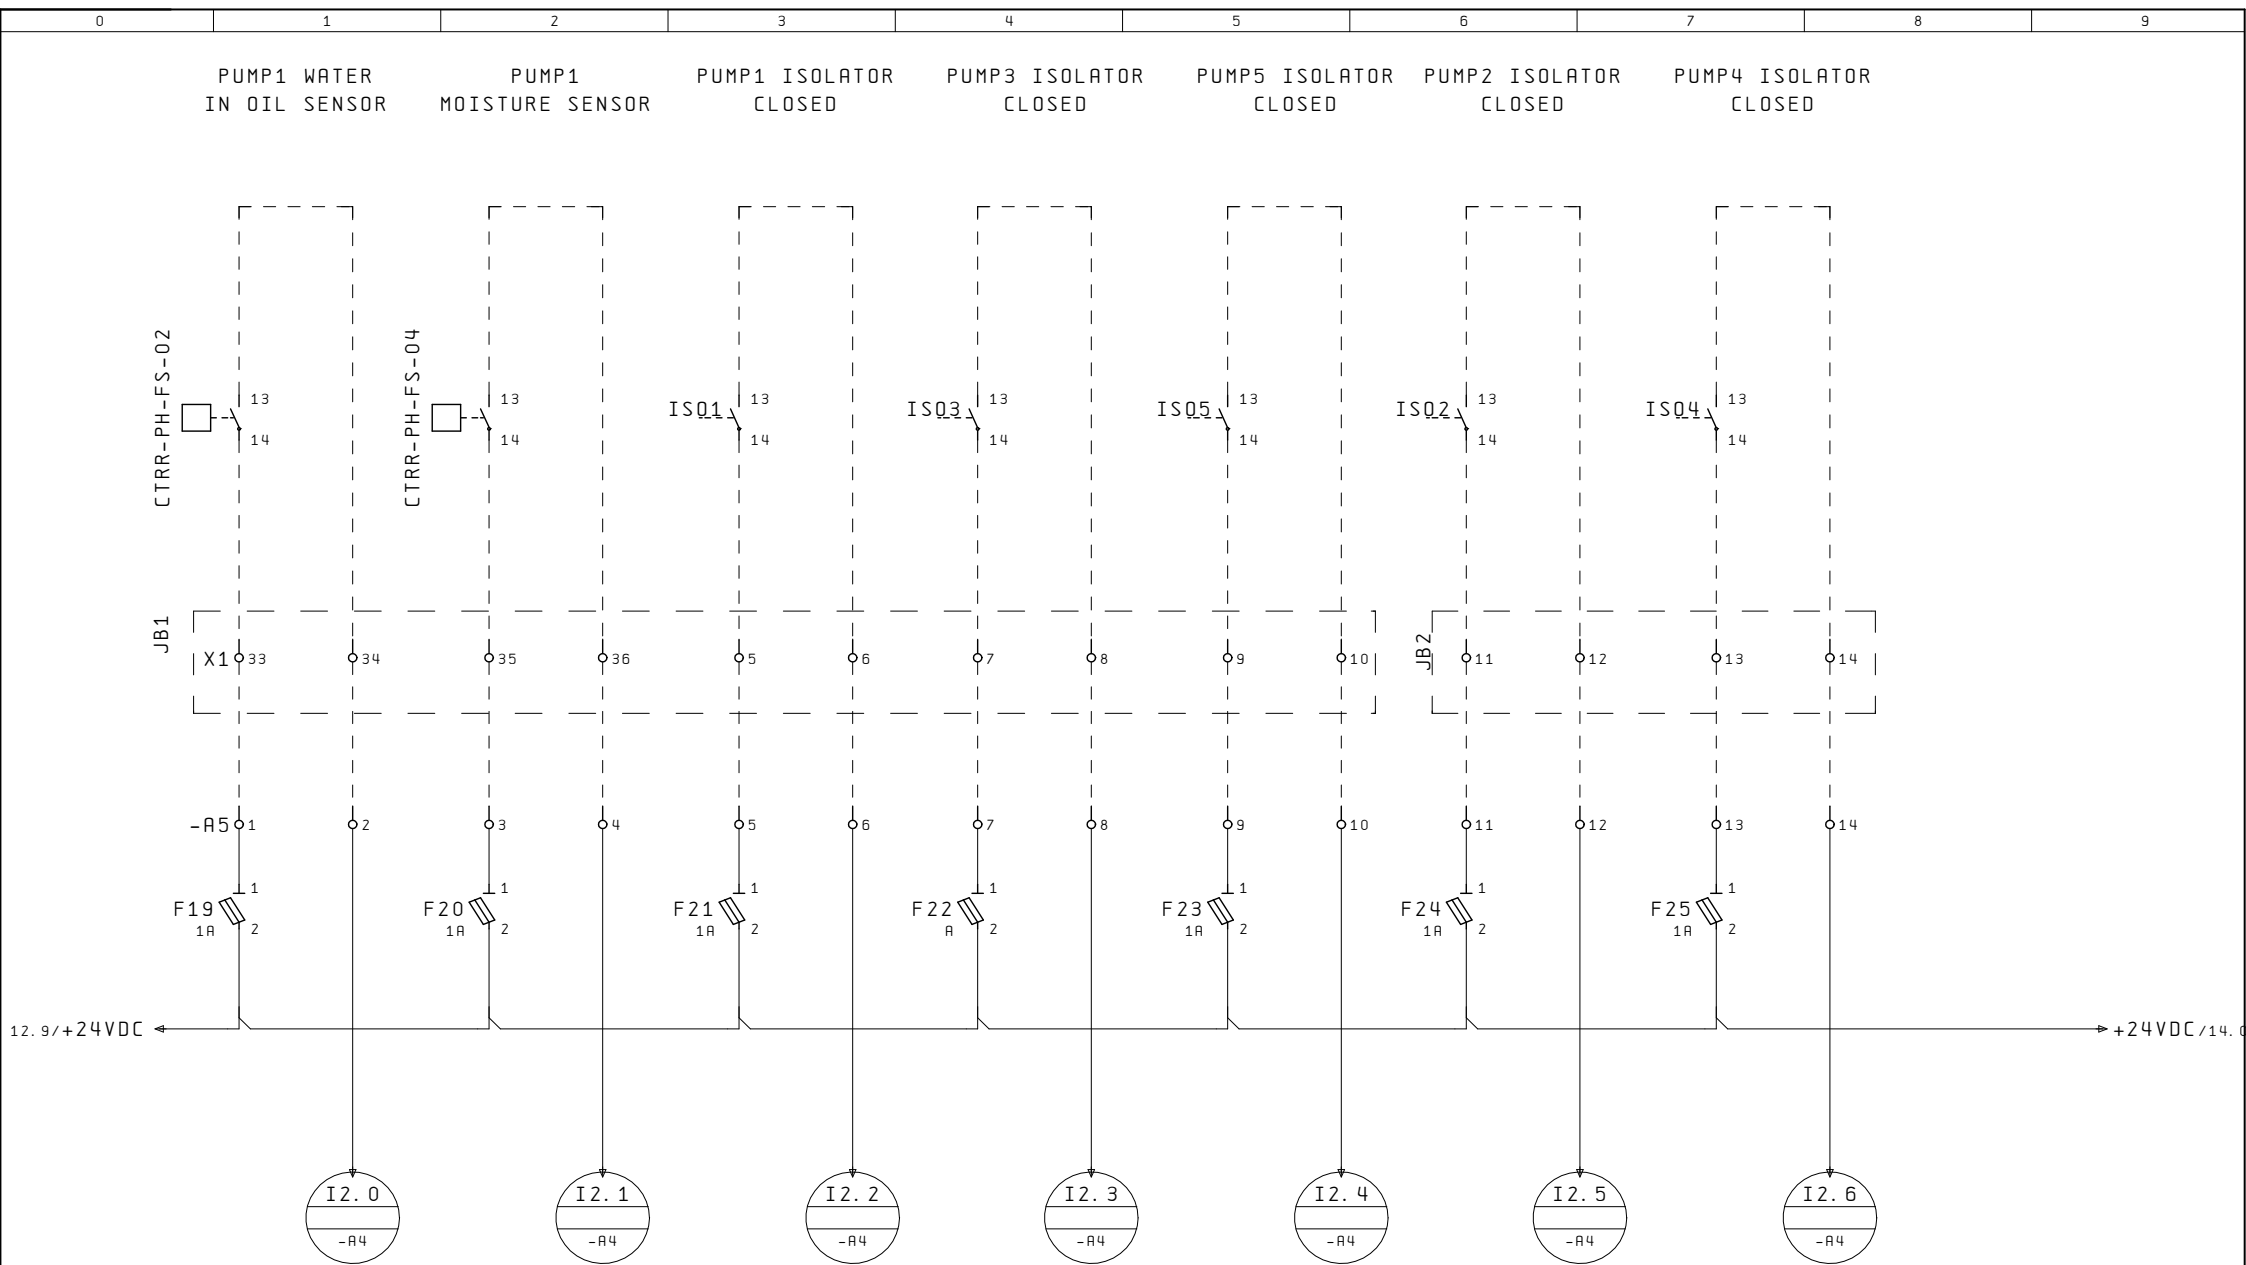



			Date		ROBINSON DRY DOCK		POWER7LO Electrical Automation (043) 731 2001	DIGITAL INPUT JBOX 1 & JBOX 2					
			Editor	B. G									
			Tested	22. Sep. 2022									
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.			B. GOVENDER	POW RODRIO		P. 13 24 p.

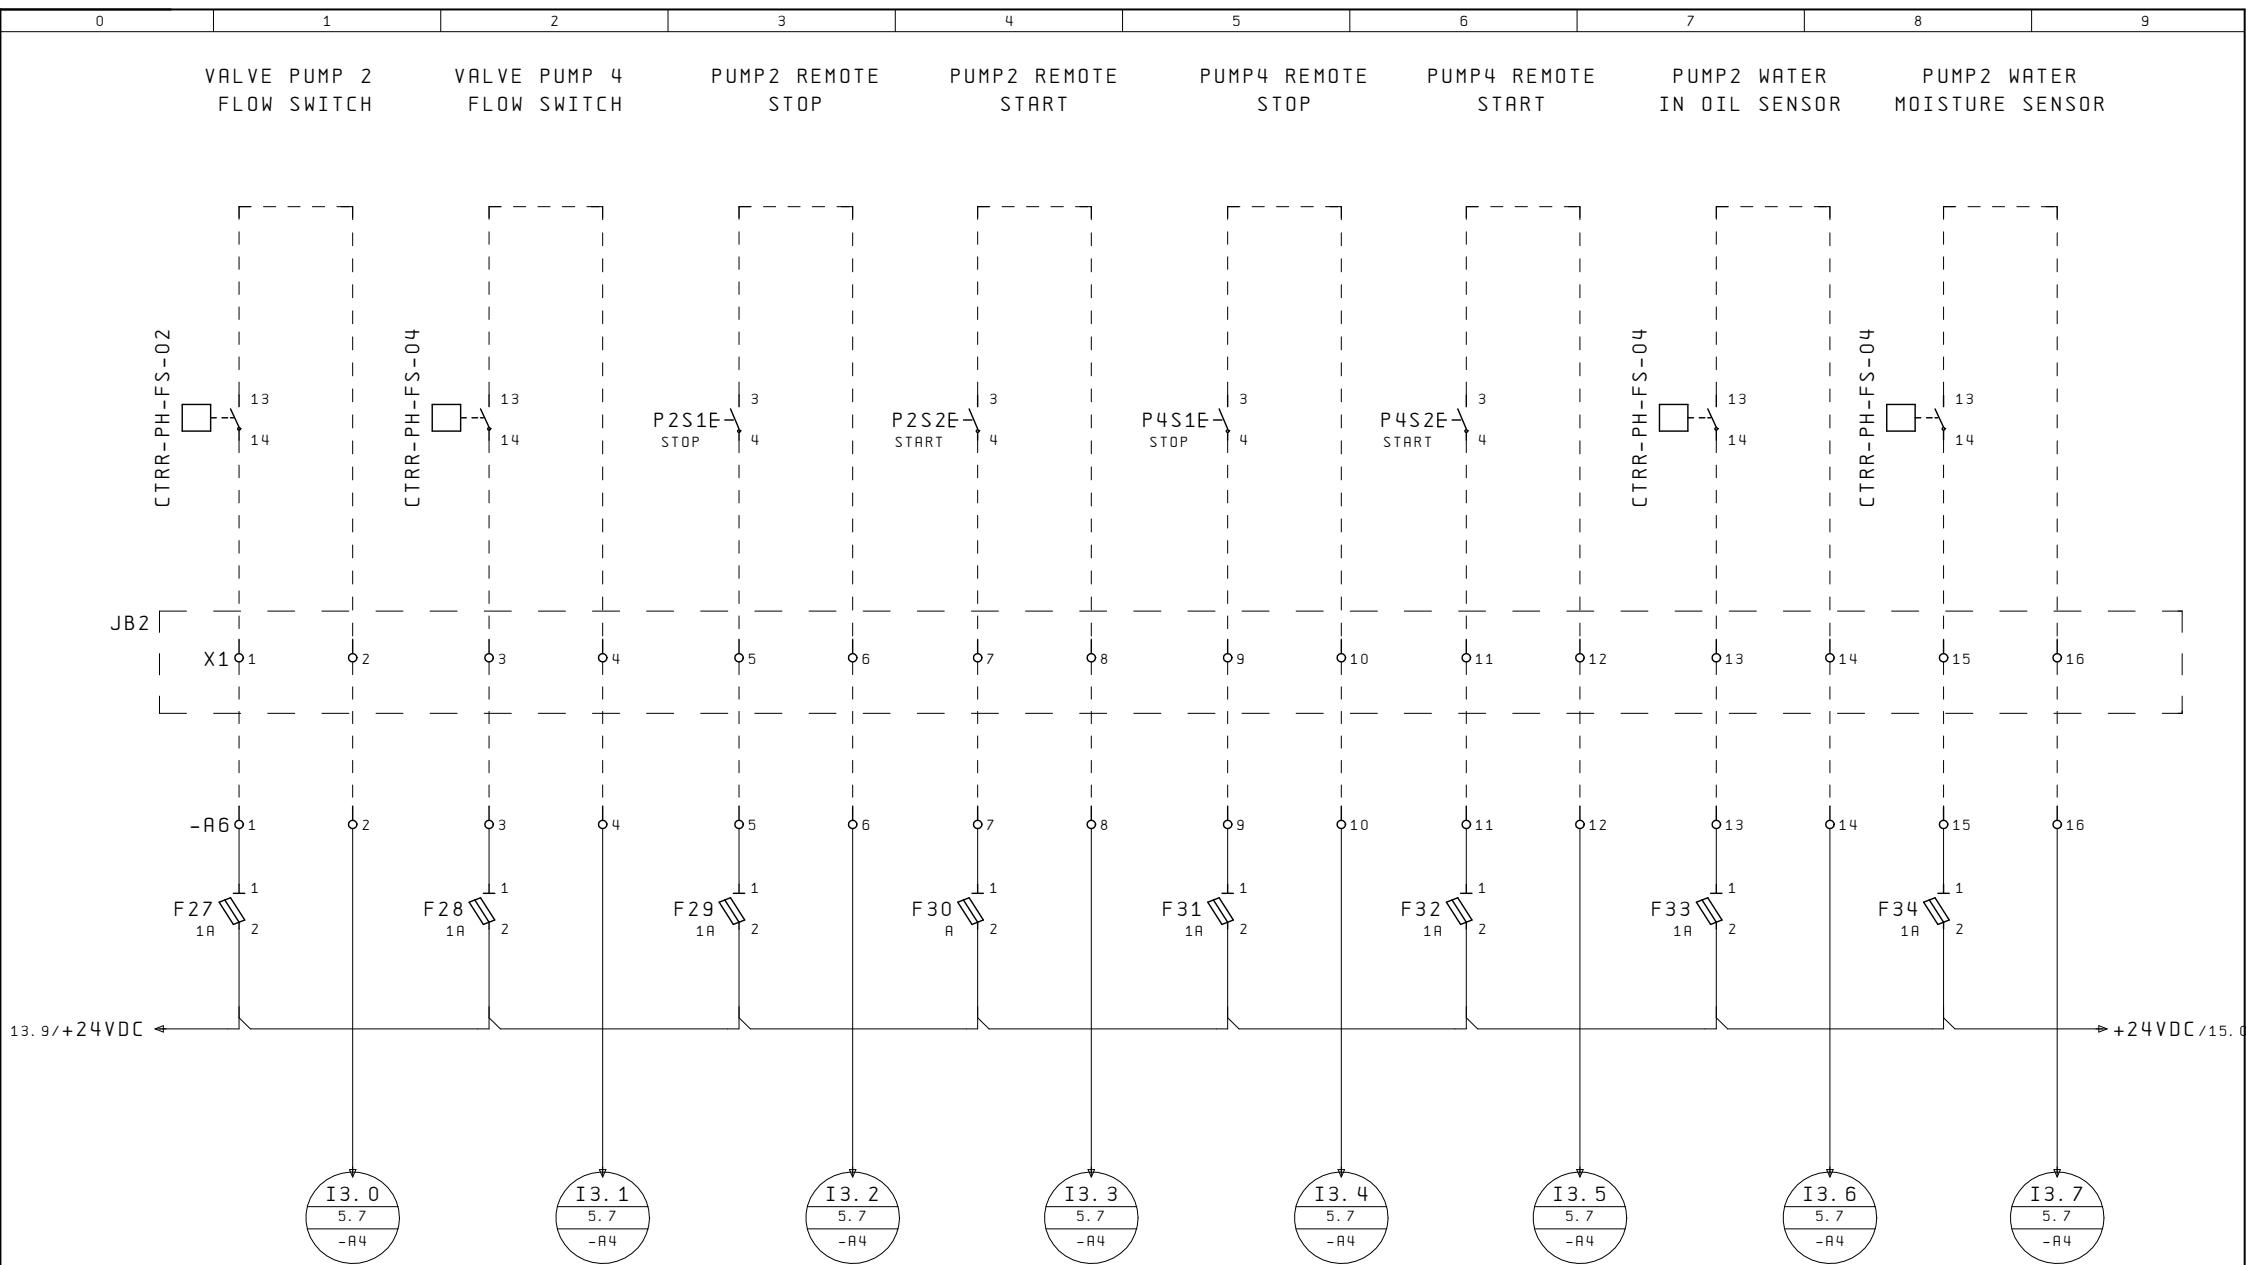

			Date		ROBINSON DRY DOCK			POWER7LO Electrical Automation (043) 731 2001	DIGITAL INPUTS JBOX 2					
			Editor	B. G										
			Tested	22. Sep. 2022										
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.			B. GOVENDER	POW RODRIO		P. 14	
														24 p.

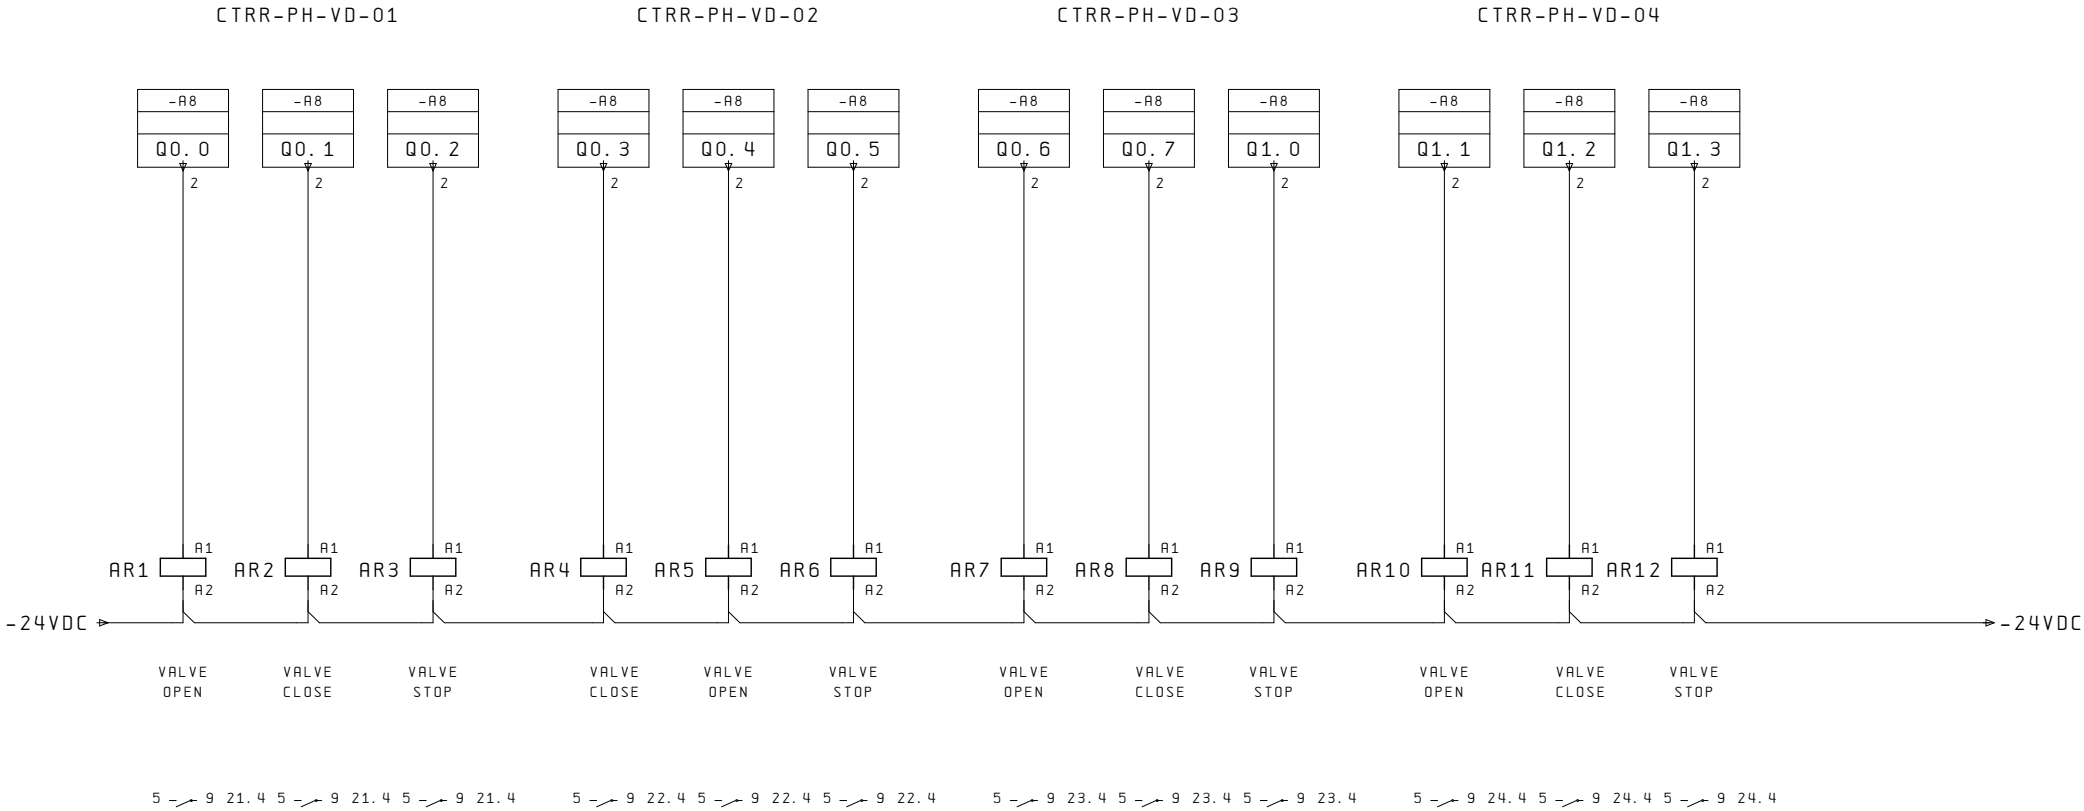


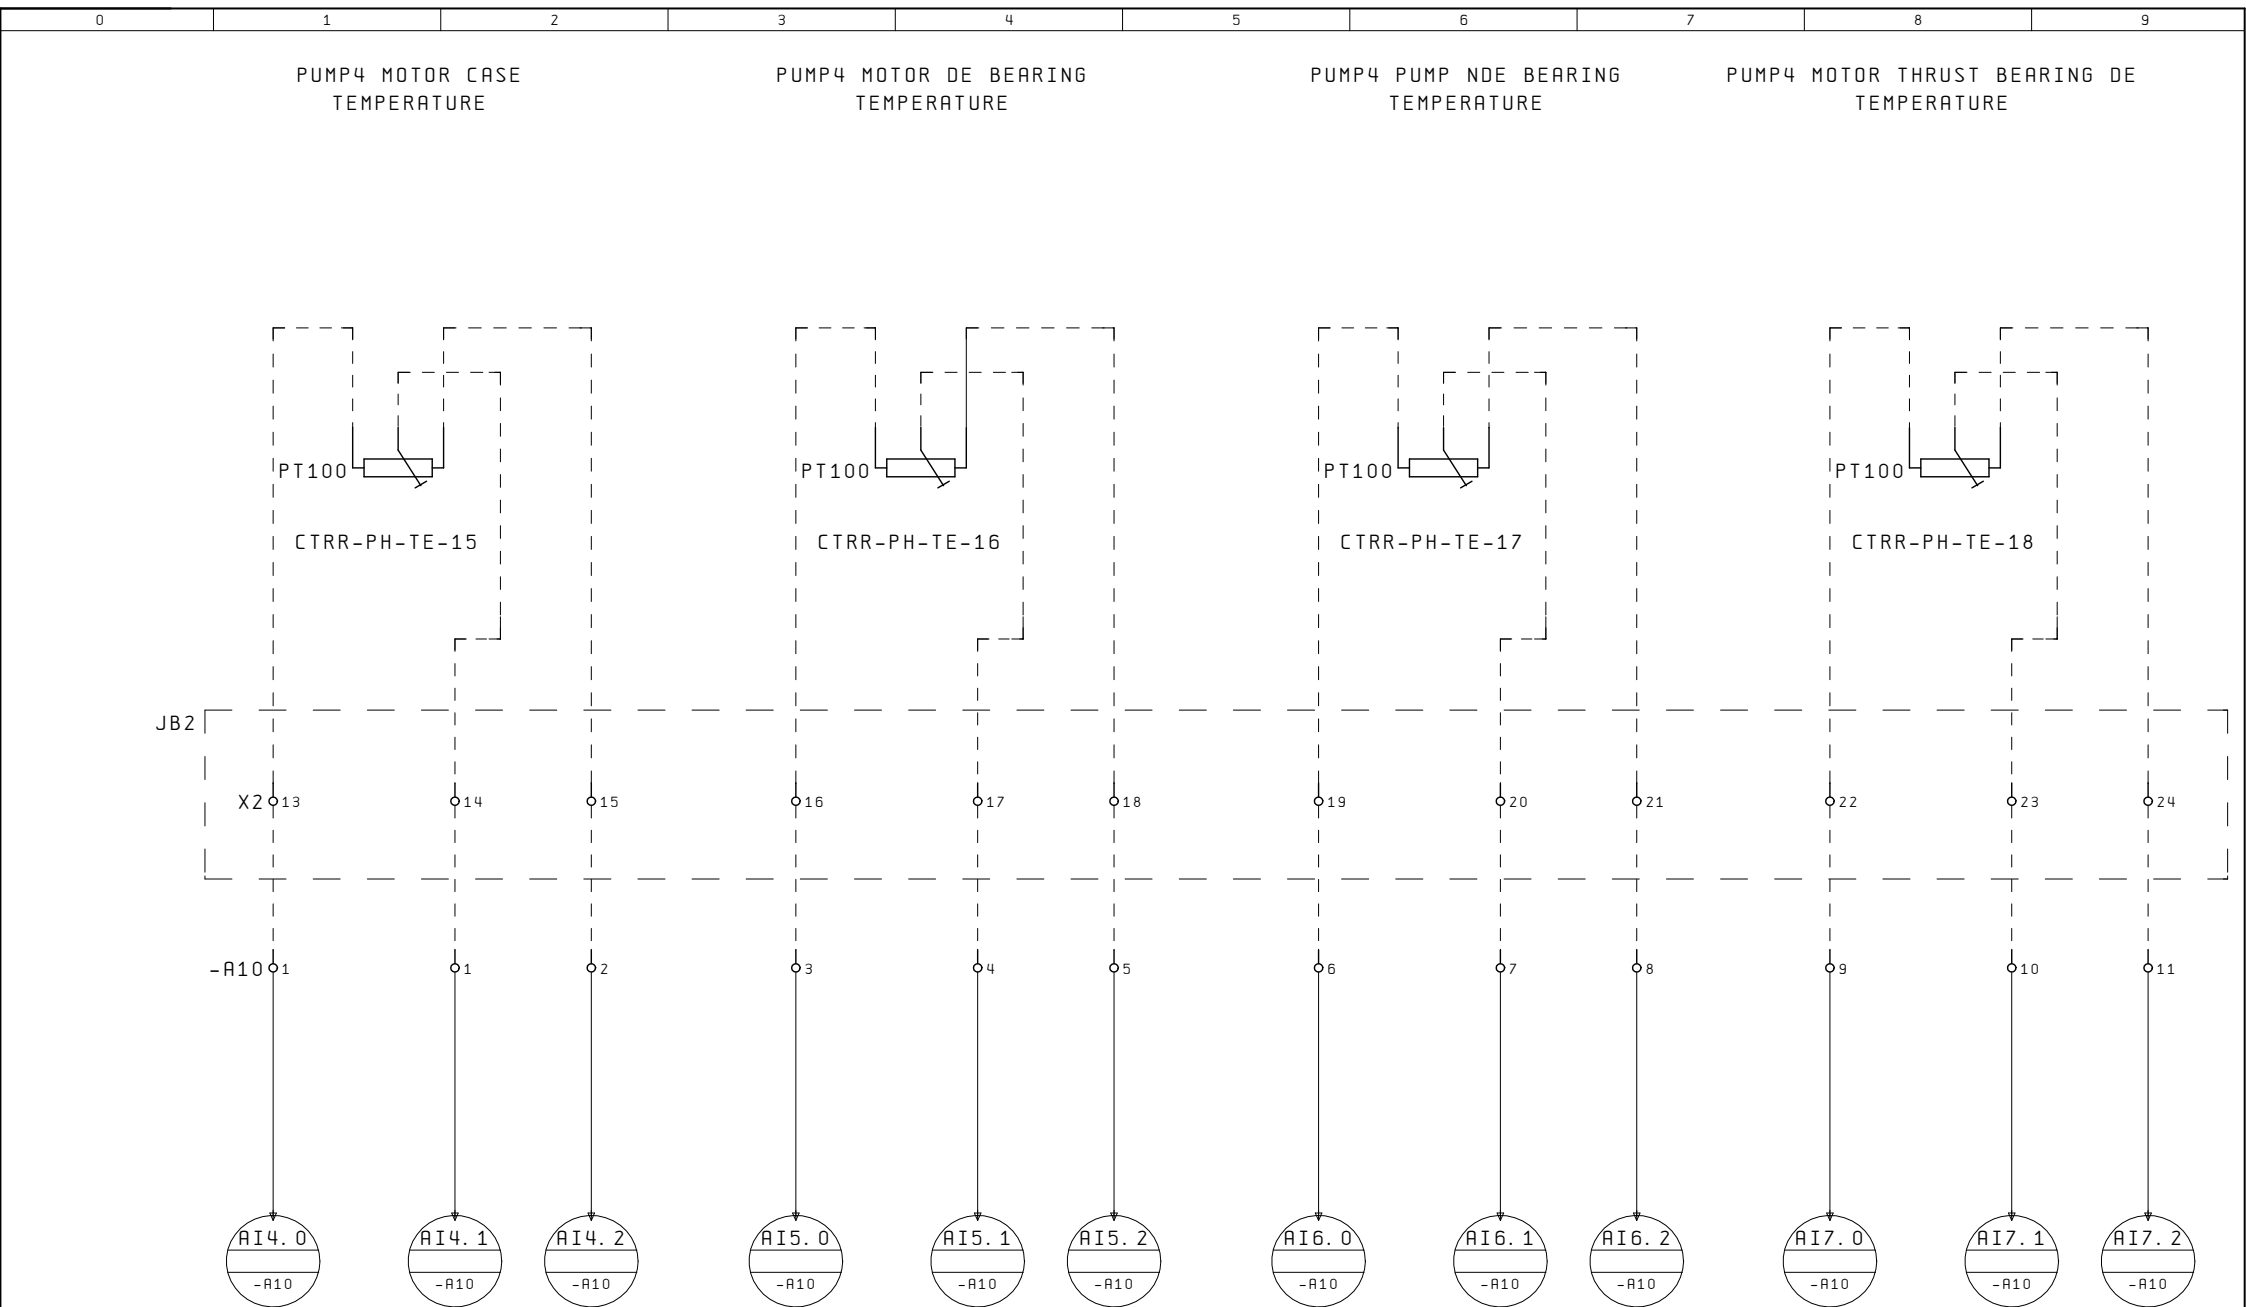


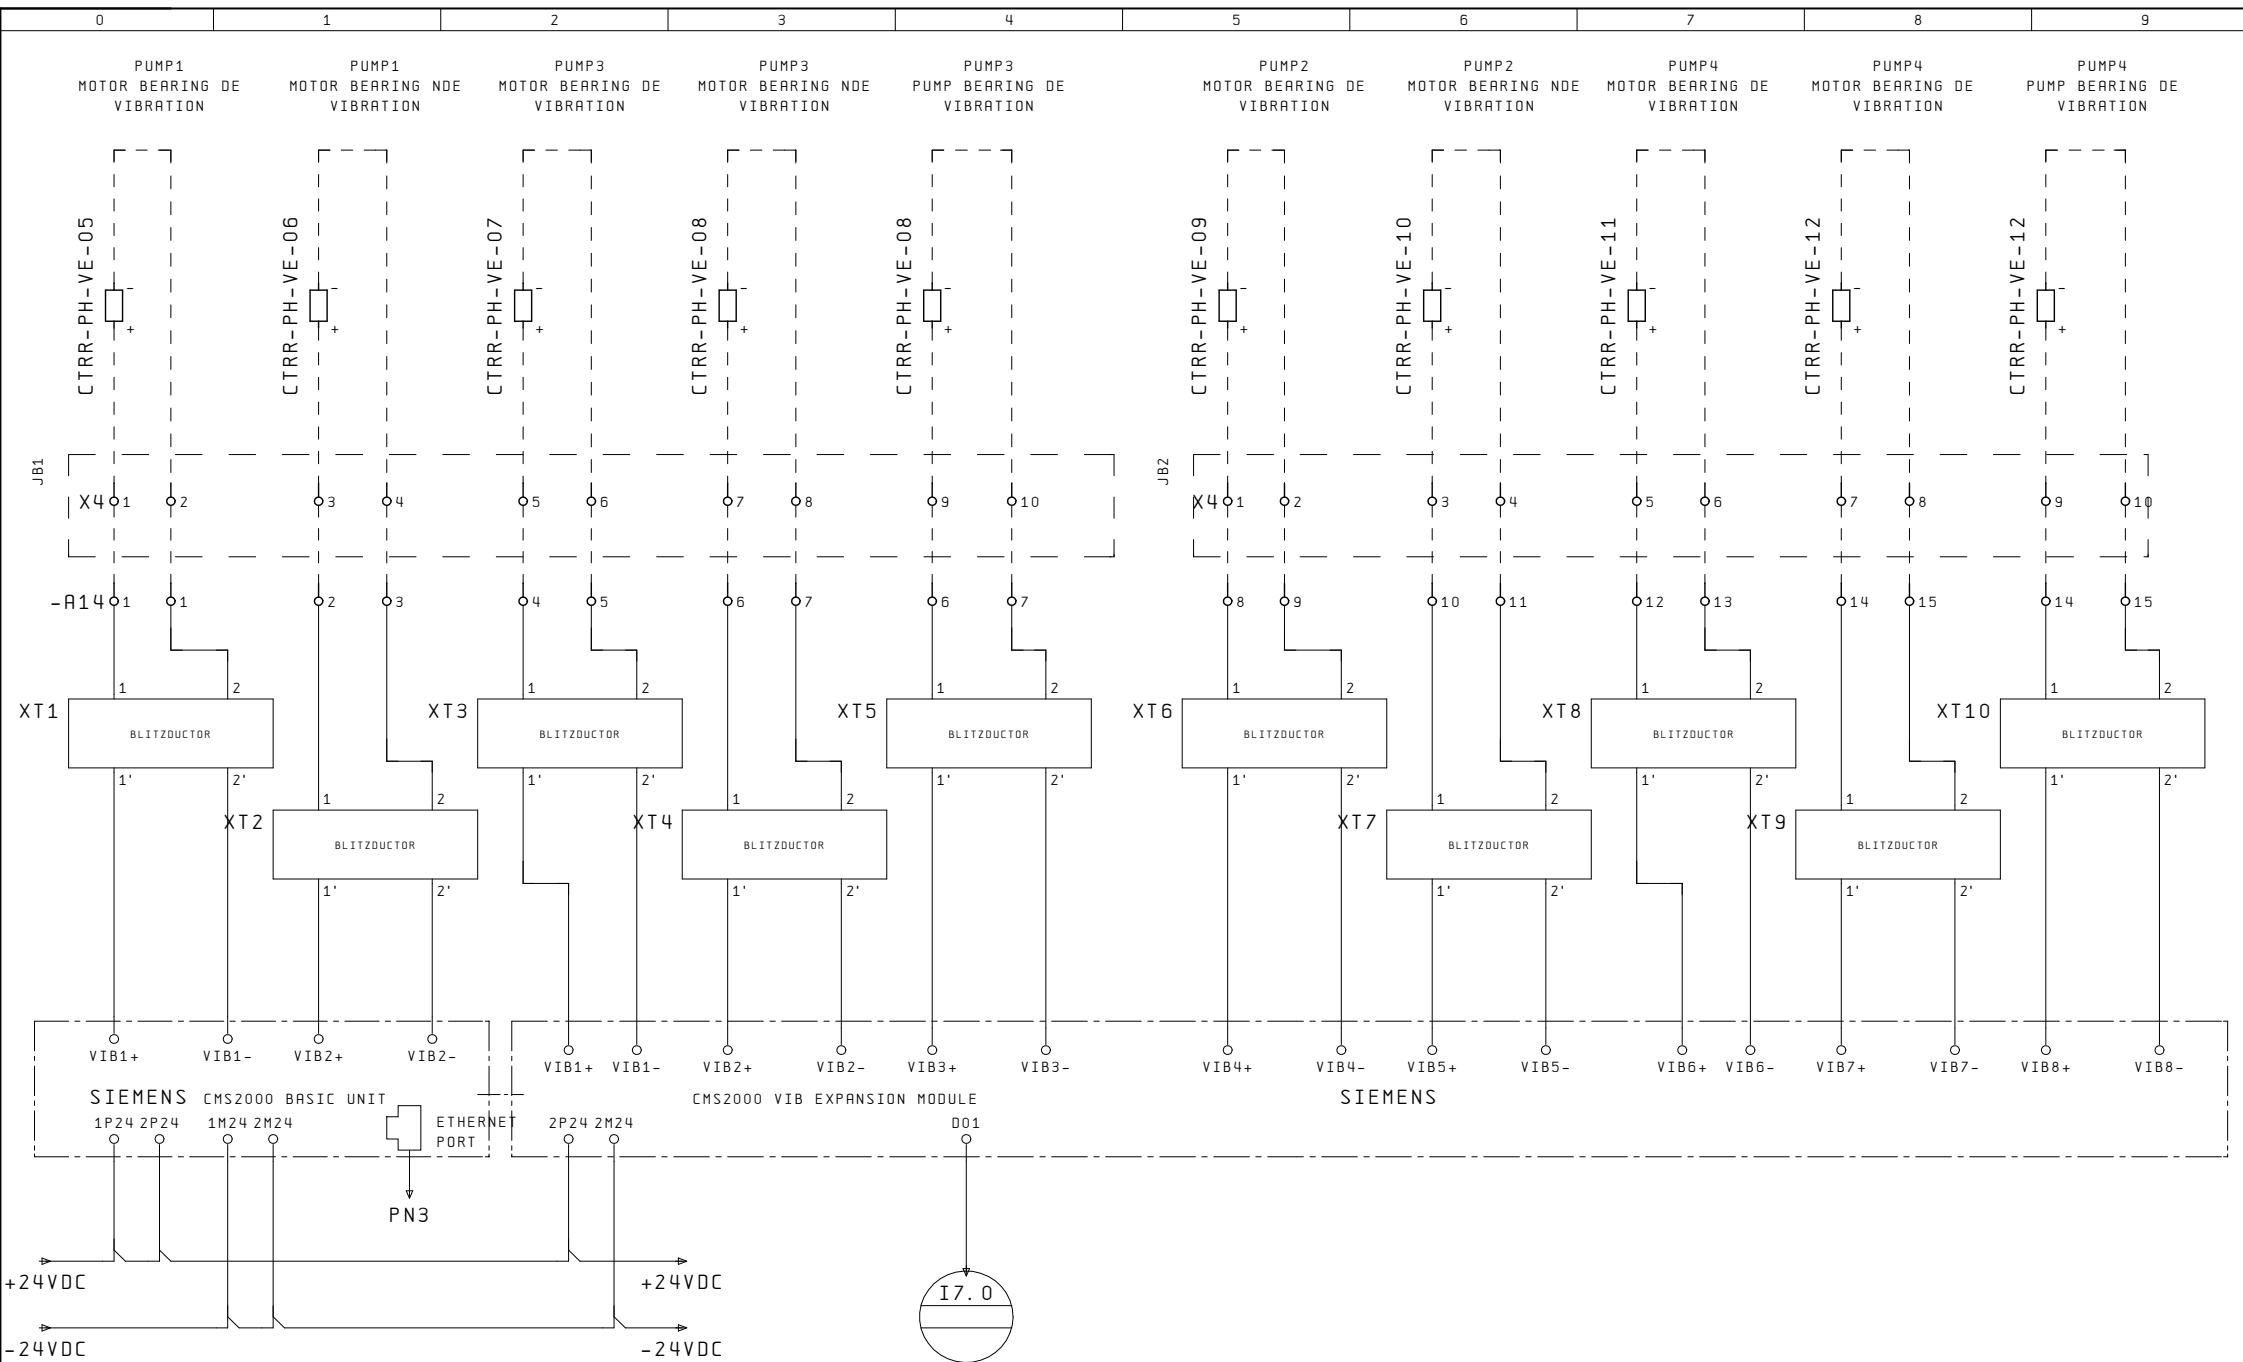

COMMON VIBRATION FAULT

17				19			

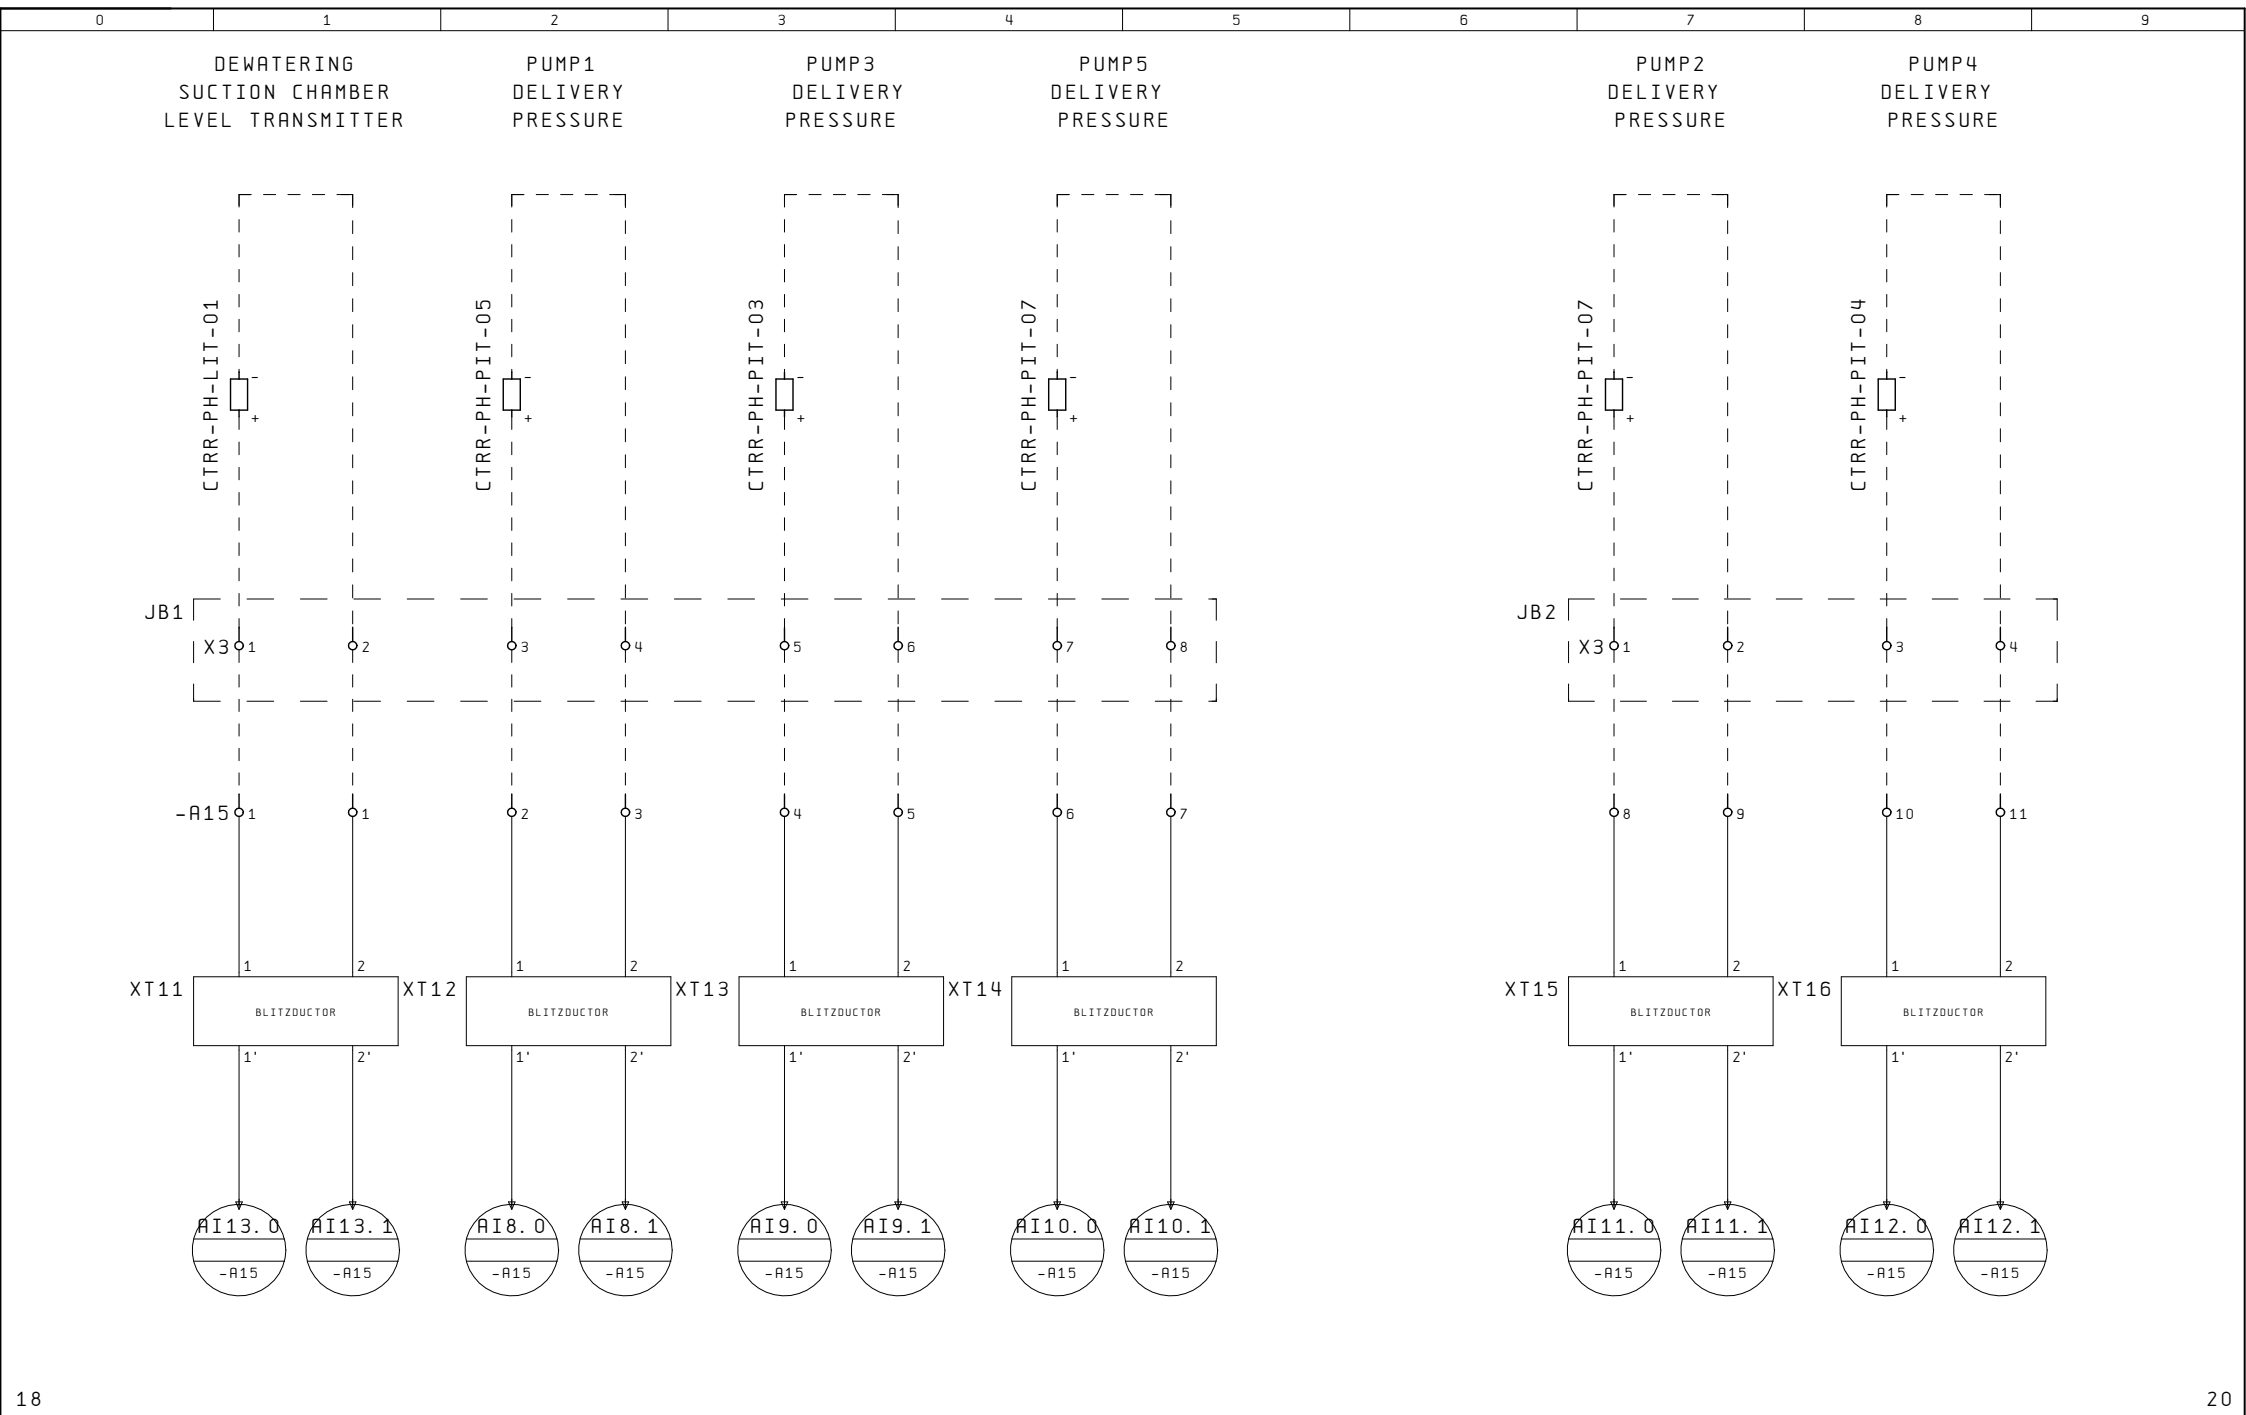

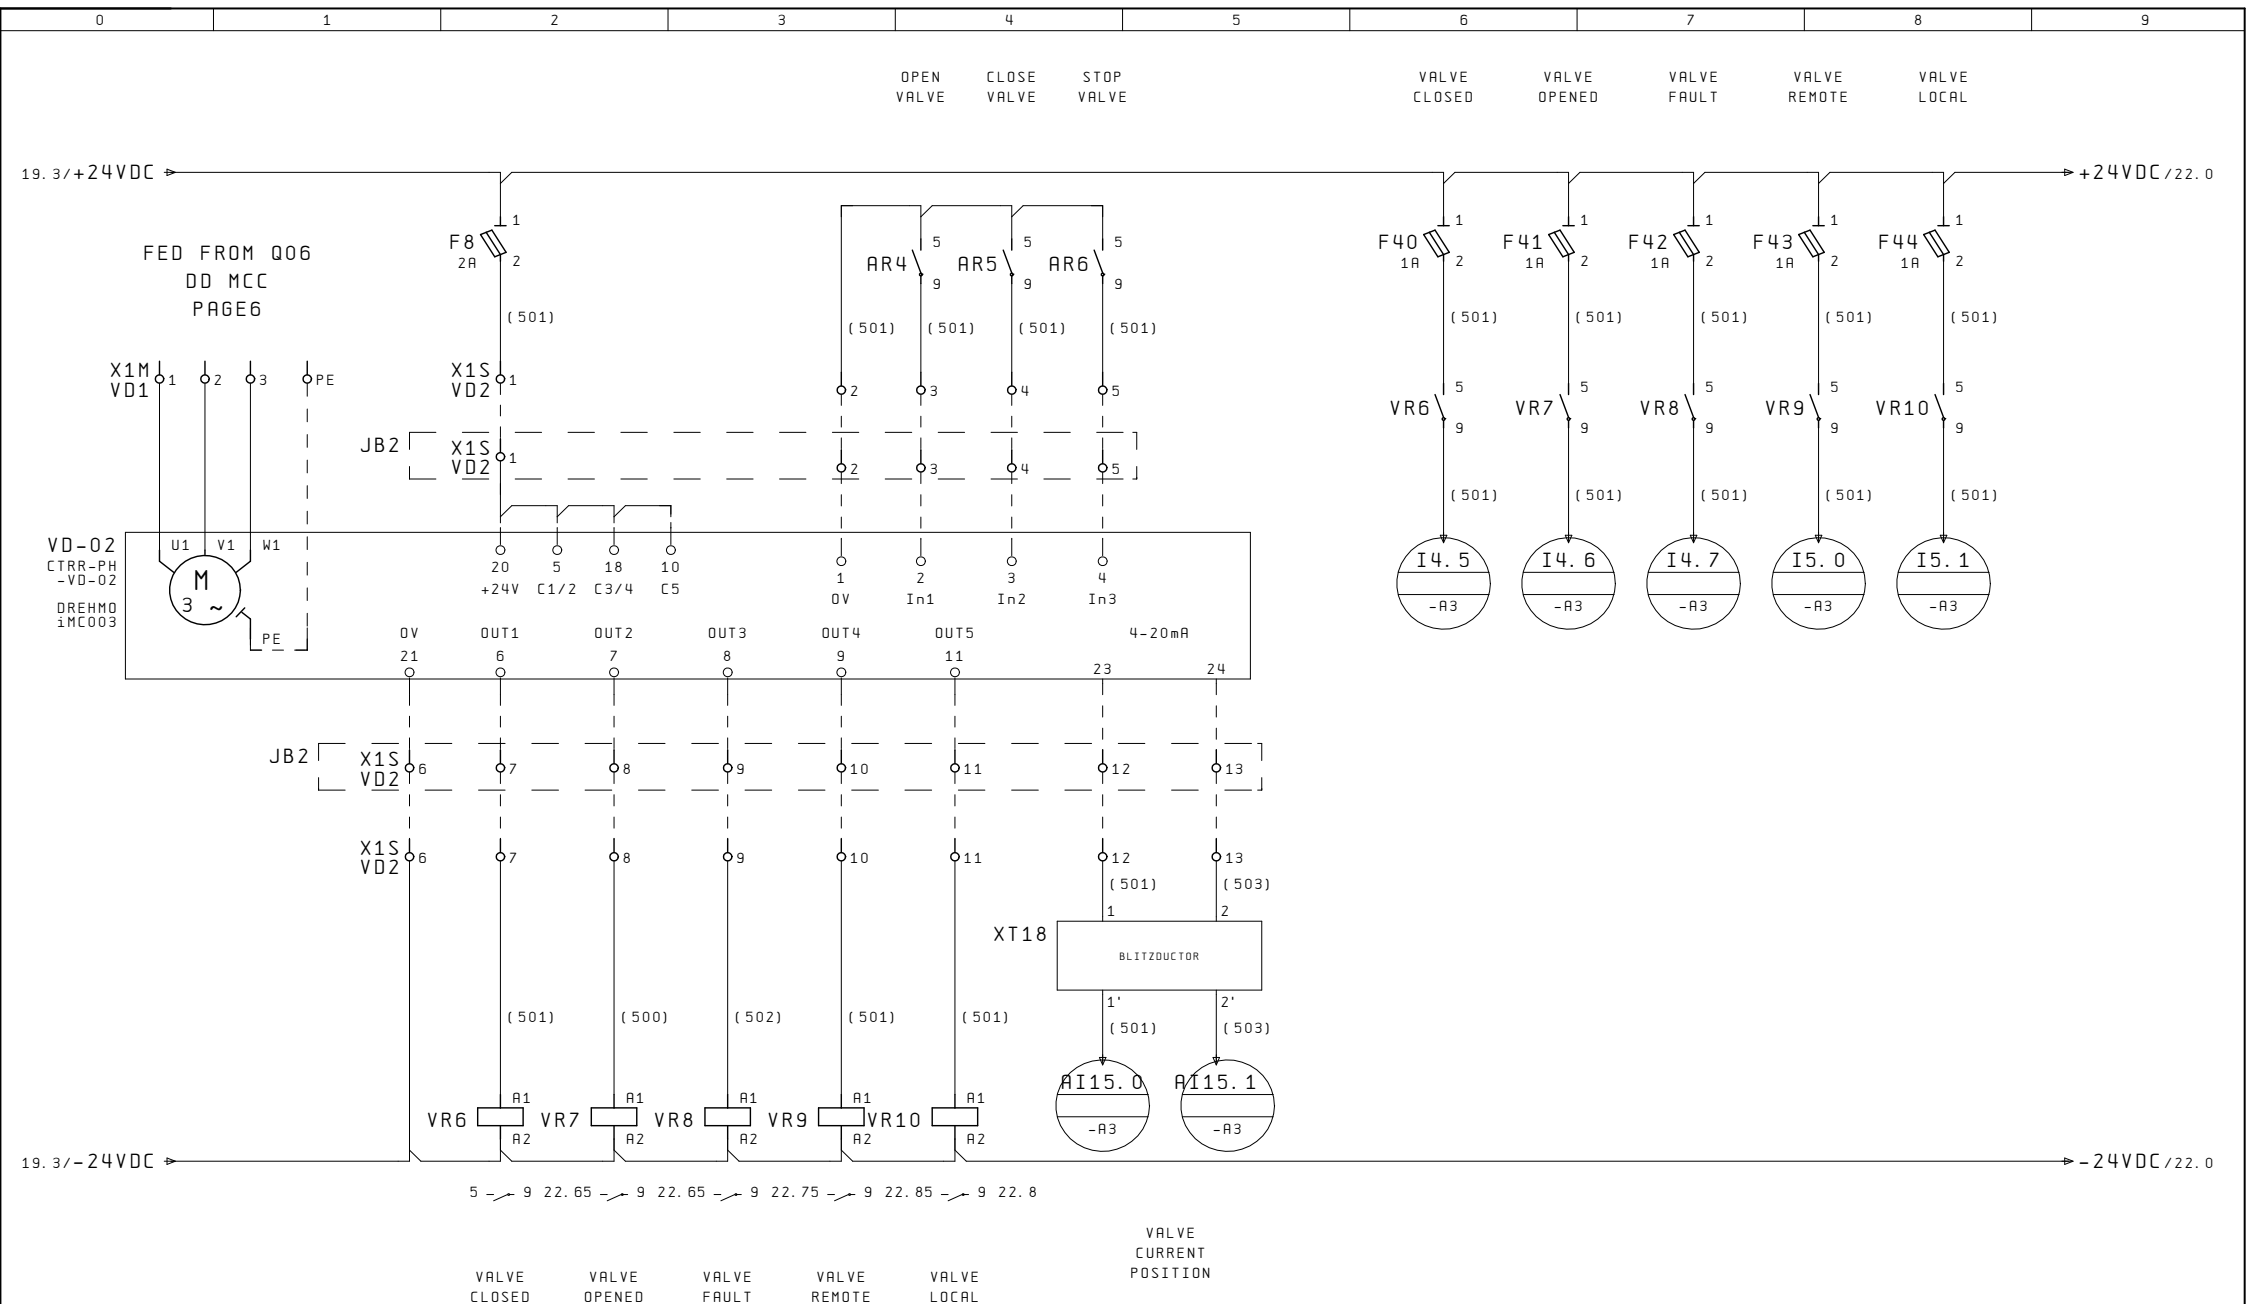

			Date		ROBINSON DRY DOCK		 Electrical Automation (043) 731 2001	PUMP 2 DELIVERY VALVE CTRR-PH-VD-02				=	
		Editor	B. G	+									
		Tested	22. Sep. 2022							B. GOVENDER		POW RODRIO	
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.					24 p.	

