






Metal oxide surge arrester

1664 Dr(E)

Bearbeit.	10.09.07	Lücke
Gepüft	28.05.13	Sehllipour

TRIDELTA
Überspannungsableiter GmbH

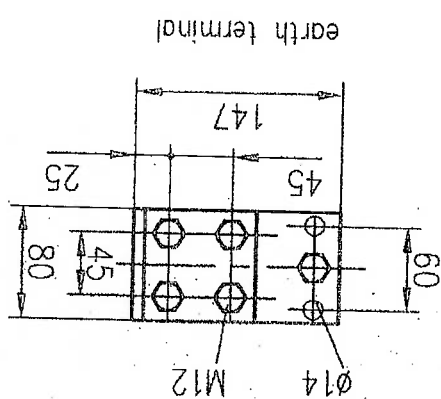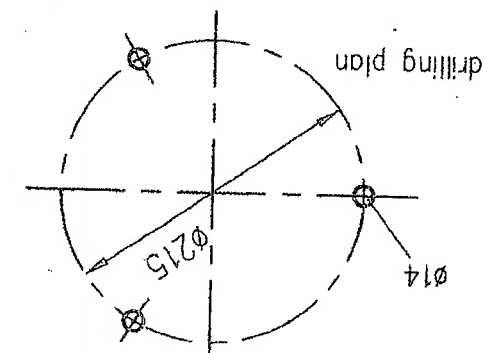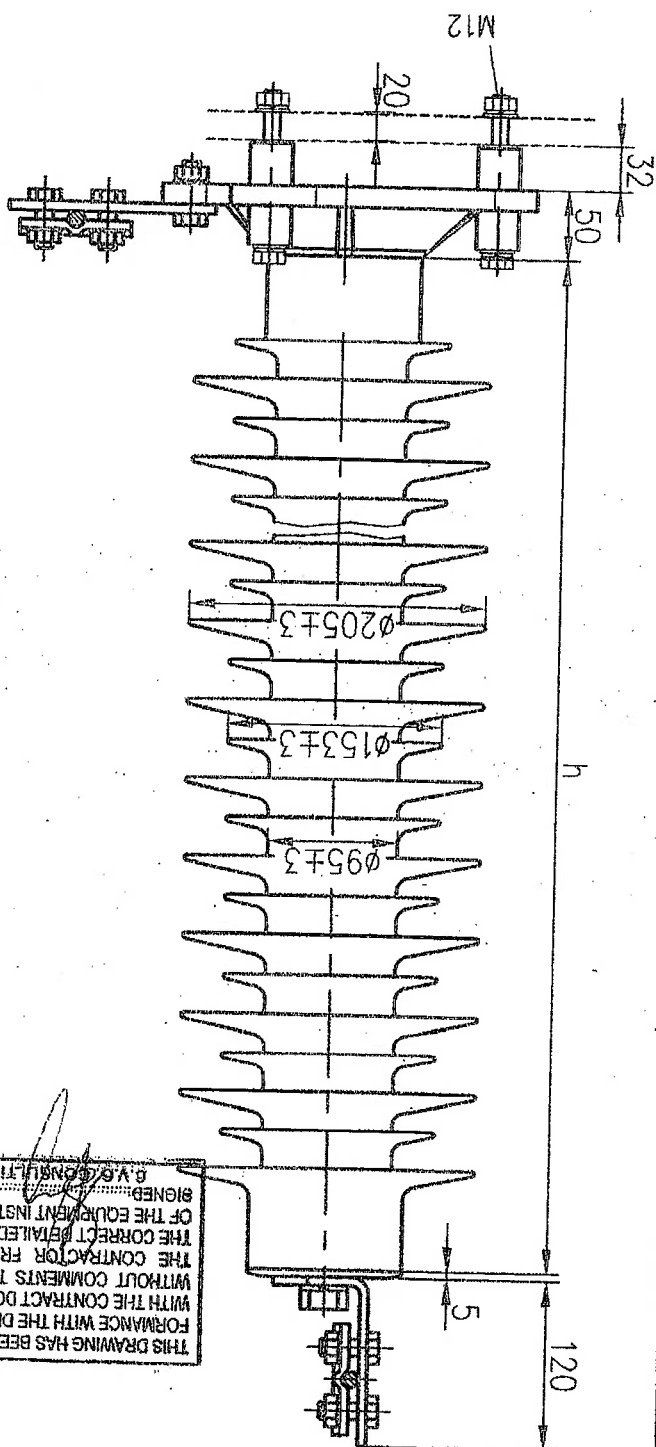


weight: app. 17 kg

creepage distance: 1405 mm

h = 497 mm

SBKC 12/20.4

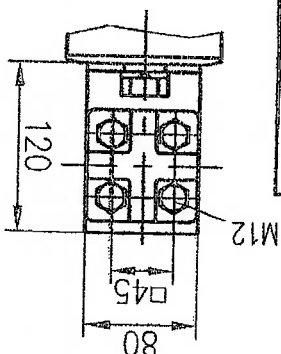

THIS DRAWING HAS BEEN REVIEWED FOR GENERAL CON-
FORMANCE WITH THE DESIGN CONCEPT IN ACCORDANCE
WITH THE CONTRACT DOCUMENTS IT IS RETURNED WITH/
WITHOUT COMMENTS THIS REVIEW DOES NOT RELIEVE
THE CONTRACTOR FROM ALL RESPONSIBILITY FOR
THE CORRECT DETAILED ENGINEERING AND FUNCTIONING
OF THE EQUIPMENT INSTALLATION
SIGNED: 29/01/2014
B.V.O. CONSULTING ENGINEERS (PTY) LTD

line terminal

earth terminal

drilling plan