



Metal oxide surge arrester

1664 Dr(E)





THIS DRAWING HAS BEEN REVIEWED FOR GENERAL CONFORMANCE WITH THE DESIGN CONCEPT IN ACCORDANCE WITH THE CONTRACT DOCUMENTS. IT IS RETURNED WITHOUT COMMENTS THIS REVIEW DOES NOT RELIEVE THE CONTRACTOR FROM ALL RESPONSIBILITY FOR THE CORRECT DETAILED ENGINEERING AND FUNCTIONING OF THE EQUIPMENT INSTALLATION.
SIGNED: *[Signature]* DATE: 29/01/2014
B.W. CONSULTING ENGINEERS LTD LTH

SBKC 132/20.4

h = 1505 mm

creepage distance: 5100 mm

weight: app. 42 kg

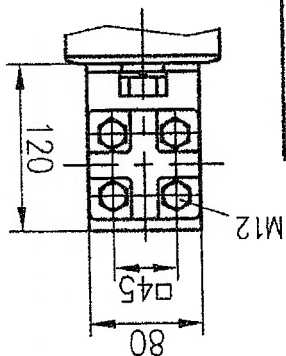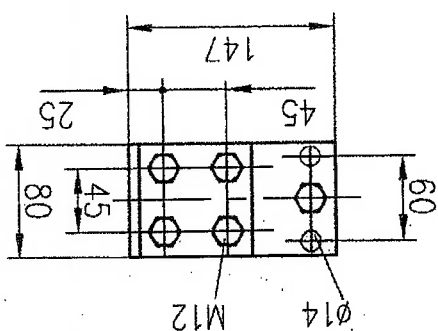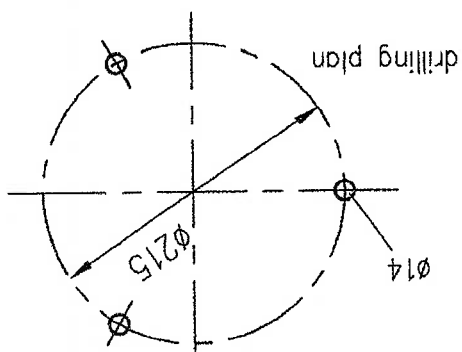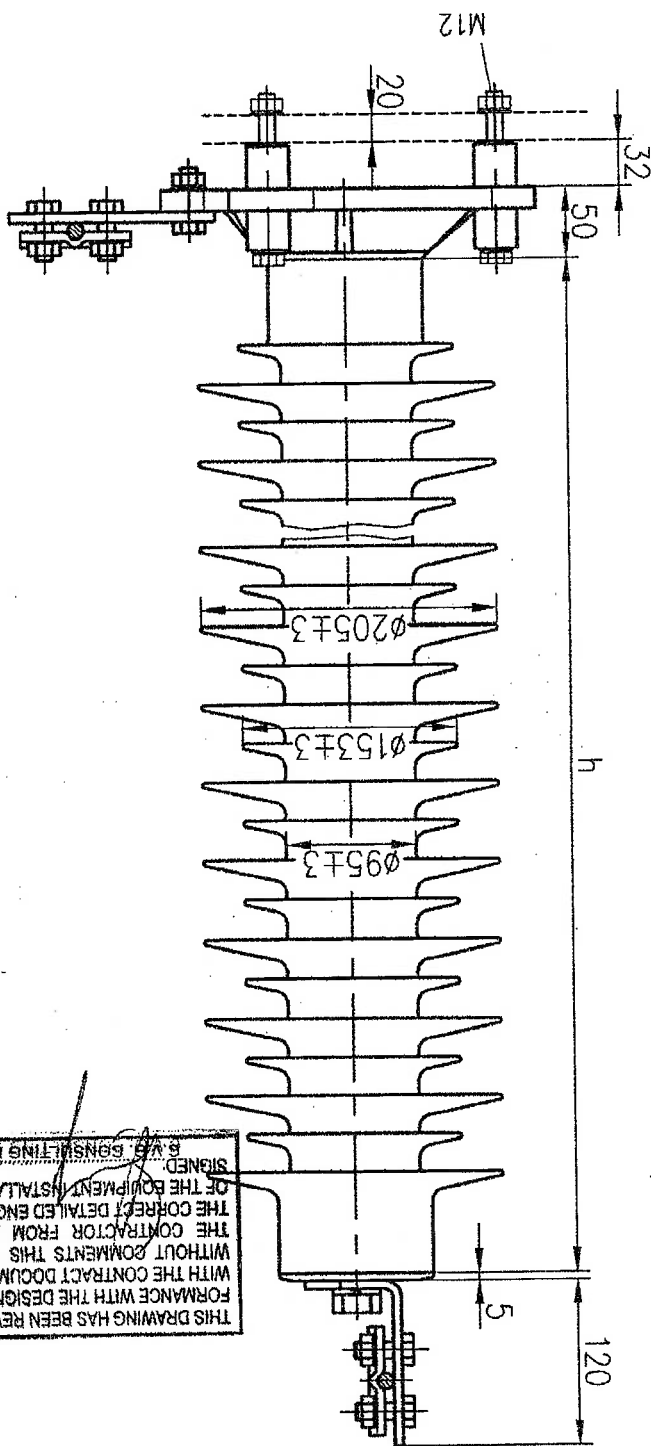

TRIDELTA
Überspannungsableiter GmbH

Geprüft: 28.05.13 Schellipour
Bearbeitet: 10.09.07 Lucke